
FISH SCALE SHINGLE INSTALLATION DETAILS

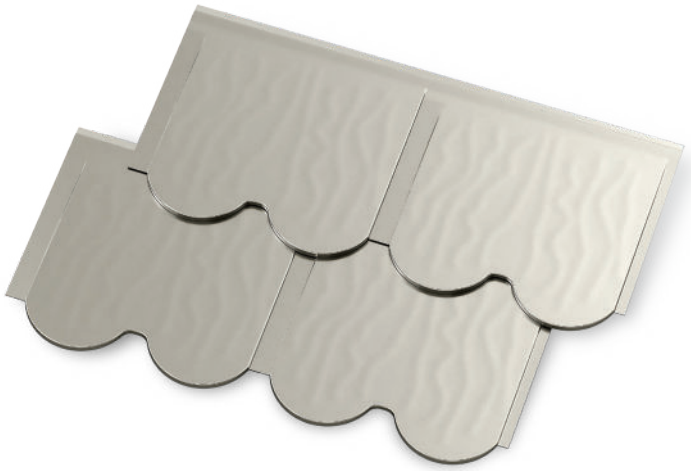

BERRIDGE MANUFACTURING COMPANY

Roofs of Distinction

800-669-0009 • www.Berridge.com

INDEX	FSS–0
INSTALLATION INSTRUCTIONS	FSSI–1
INSTALLATION INSTRUCTIONS	FSSI–2
INTRODUCTION TO TYPICAL DETAILS	FSSI–3
SHINGLE OVERVIEW	FSS–1
FASCIA DETAIL; BELOW EAVE	FSS–10
FASCIA DETAIL; BELOW GABLE	FSS–11
FASCIA SILL	FSS–20
FASCIA OUTSIDE CORNER	FSS–21
FASCIA END WALL	FSS–22
FASCIA PARAPET	FSS–23
FASCIA/SOFFIT DETAIL;	FSS–30
FASCIA/SOFFIT DETAIL;	FSS–31
WALL/SOFFIT DETAIL;	FSS–32
SILL AT SLAB DETAIL;	FSS–40
SILL AT SLAB DETAIL;	FSS–41
SILL AT BRICK DETAIL;	FSS–42
SILL AT VERTICAL PANEL DETAIL;	FSS–43
HEADER DETAIL;	FSS–50
WINDOW/DOOR JAMB;	FSS–51
JAMB DETAIL;	FSS–52
SILL DETAIL;	FSS–53
INSIDE CORNER DETAIL;	FSS–60
OUTSIDE CORNER DETAIL;	FSS–61
PARAPET DETAIL;	FSS–70
HEAD WALL DETAIL;	FSS–71
RAKE WALL DETAIL;	FSS–72

1. BERRIDGE FISH SCALE SHINGLE: HAS AN EXPOSURE OF NOMINAL 11–1/2" X 8 1/2" AND HAS A DEPTH OF 5/16" AT BOTTOM OF SHINGLE AND FLUSH AT THE TOP.

   THE SHINGLE IS FACTORY FABRICATED. WITH 148 SHINGLES PER SQUARE.

GENERAL NOTES

1. SHINGLES MAY BE USED FOR GABLE, SIDEWALL, FASCIA OR MANSARD WITH 80 DEGREE + SLOPE.

2. SHINGLES TO BE INSTALLED OVER SOLID SHEATHING.

A. MATERIAL STORAGE: CAUTION MUST BE EXERCISED IN THE STORAGE OF MATERIALS PRIOR TO INSTALLATION. KEEP ALL BERRIDGE PRE FINISHED MATERIAL IN A DRY LOCATION WITH ADEQUATE VENTILATION AND OUT OF DIRECT SUNLIGHT.

   EXPOSURE TO DIRECT SUNLIGHT AND/OR MOISTURE MAY CAUSE THE FACTORY–APPLIED STRIPPABLE PROTECTIVE PLASTIC FILM TO ADHERE TO THE METAL PERMANENTLY AND CAUSE DISCOLORATION OF THE FINISH.

B. STRIPPABLE PROTECTIVE FILM: THE STRIPPABLE PLASTIC FILM WHICH IS APPLIED OVER MOST BERRIDGE PRE FINISHED PRODUCTS, PANELS, FLASHINGS, COILS AND SHEETS PROVIDES PROTECTION OF THE FINISH DURING FABRICATION AND TRANSIT. THIS FILM MUST BE REMOVED PRIOR TO INSTALLATION.

C. SHEATHING: SOLID SHEATHING IS TO BE EITHER BERRIDGE 24 GA "S–DECK" CORRUGATED METAL DECKING OR A MINIMUM OF 1/2" SOLID WOOD SHEATHING TO PROVIDE SUFFICIENT HOLDING STRENGTH FOR FASTENERS. SHEATHING TO BE IN PLANE ± 1/4" IN 20'.

D. FELT UNDERLAYMENT: USE NUMBER THIRTY (# 30) FELT PAPER (OR EQUAL) BENEATH SHINGLES. INSTALL FELT PARALLEL TO BASE OF PANELS, STARTING AT THE BOTTOM AND USING MINIMUM 6" LAPS. USE ONLY BERRIDGE COATED FELT CAPS TO PREVENT RUST. USE ONLY GALVANIZED OR COATED FASTENERS.

   MINIMUM # 30 FELT UNDERLAYMENT AT STRAIGHT WALL APPLICATIONS; GRACE ICE & WATERSHIELD UNDERLAYMENT (OR EQUAL) AT MANSARD APPLICATIONS (MANSARDS 80 DEGREE + SLOPE

   DO NOT USE RED ROSIN PAPER WITH ANY BERRIDGE MANUFACTURING PRODUCT.

E. SEALANT RECOMMENDATIONS: TREMCO SPECTRUM ONE SILICONE SEALANT. DO NOT USE CLEAR CAULK.

F. ELECTROLYSIS: AVOID ALLOWING FLASHINGS AND SHINGLES TO COME INTO CONTACT WITH EITHER LEAD OR COPPER, AND PREVENT EXPOSURE TO WATER RUN OFF FROM LEAD AND/OR COPPER.

G. STRUCTURAL FRAMING: PRIOR TO SHINGLE INSTALLATION, INSPECT SIDEWALL, FASCIA OR OTHER FRAMING TO DETERMINE:

1. FRAMING MUST BE SQUARE AND PLUMB.

2. INSURE THAT SIDEWALL COLUMNS AND GIRTS ARE IN THE SAME PLANE, PLUS OR MINUS 1/4" IN 20'.

H. FLASHING: IF BERRIDGE MANUFACTURING COMPANY IS TO SUPPLY FLASHINGS, THEY WILL BE FABRICATED IN 10'–0" LENGTHS WITH SQUARE END CUTS ONLY. THE PURCHASER MUST PROVIDE ALL DIMENSION AND DEGREE OF ANGLES.

I. FLASHING INSTALLATION: FIRST, REMOVE STRIPPABLE PLASTIC FILM FROM ALL FLASHINGS, THEN INSTALL ACCORDING TO BERRIDGE TYPICAL INSTALLATION DETAILS. ALWAYS STAGGER FLASHING JOINTS WHEN ONE FLASHING IS INSTALLED OVER OTHER FLASHINGS.

J. SHINGLE INSTALLATION:

1. REMOVE STRIPPABLE PLASTIC FILM FROM EACH SHINGLE PRIOR TO INSTALLATION.
2. START SHINGLE INSTALLATION FROM BOTTOM OF WALL OR SILL AND WORK UP TO TOP OF WALL.
3. KEEP EACH SHINGLE TIGHT AGAINST THE ADJOINING SHINGLE.
4. SHINGLE SIDE JOINTS SHALL BE PERPENDICULAR TO SILL.

K. FASTENERS: INSTALL FASTENERS AS PER TYPICAL DETAILS. USE 11 GAUGE 1–1/4" GALVANIZED ROOFING NAILS FOR INSTALLATION OVER WOOD SHEATHING AND USE #10 PANCAKE HEAD TEKS FASTENERS (ZINC–PLATED SCREW WITH PHILLIPS INSERT, AS MADE BY CONSTRUCTION FASTENERS CO.) FOR INSTALLATION TO METAL. WHEN USING POP RIVETS ON FLASHING, STAINLESS STEEL RIVETS ARE RECOMMENDED TO AVOID RUST STAINS.*

MAKE SURE ALL FASTENERS ARE DRIVEN STRAIGHT AND SET FLAT. DO NOT OVERDRIVE FASTENERS, AS THIS WILL CAUSE THE SHINGLE AND OR FLASHING TO BUCKLE OR BECOME RECESSED BELOW THE ELEVATION OF THE SUBSTRATE.

ALL FASTENERS ARE TO BE GALVANIZED, STAINLESS STEEL OR COATED.

BERRIDGE MANUFACTURING COMPANY STRIVES TO PROVIDE ITS CUSTOMERS WITH THE HIGHEST QUALITY STRETCHER LEVELED STEEL AVAILABLE. THE LATEST TECHNOLOGY IS ALSO INCORPORATED IN BERRIDGE'S HIGH–PRECISION COIL HANDLING AND ROLL FORMING EQUIPMENT TO MINIMIZE THE STRESS ON METAL DURING PRODUCTION. FURTHERMORE, BERRIDGE UTILIZES HEAVIER 24 GAUGE METAL RATHER THAN 26 GAUGE STEEL OR LIGHT GAUGE ALUMINUM AS OFFERED BY MANY COMPETITORS. ALL THESE MEASURES HAVE BEEN TAKEN TO MINIMIZE THE AMOUNT OF "OIL–CANNING" (WAVINESS) WHICH IS NATURALLY INHERENT IN FLAT SHEET METAL. MANY TIMES, HOWEVER, THE CAUSE OF WAVINESS OR "OIL–CANNING" CAN BE TRACED TO UNEVEN SHEATHING, OR IMPROPER FELT INSTALLATION.

ALL ARCHITECTURAL SHINGLES REQUIRE CARE IN HANDLING AND INSTALLATION TO AVOID DAMAGING OR DEFORMING THE SHINGLES.

*CONSULT BERRIDGE MANUFACTURING'S ENGINEERING DEPARTMENT REGARDING FASTENER SPACING TO MEET DESIGN CRITERIA, AND THE USE OF ANY OTHER TYPE OF FASTENER.

DATE: 03/22/08	INSTALLATION INSTRUCTIONS	BERRIDGE Roofs of Distinction — Berridge Manufacturing Company
PAGE\FILE FSSI-2	FISH SCALE SHINGLE	

THE DETAILS CONTAINED IN THE FOLLOWING PAGES ARE MERELY RECOMMENDATIONS AS TO HOW BERRIDGE MANUFACTURING MATERIALS SHOULD BE INSTALLED. THEY MAY REQUIRE ADAPTATIONS OR MODIFICATIONS FOR A SPECIFIC PROJECT AS CONDITIONS VARY IN BOTH BUILDING DESIGN AND LOCAL WEATHER PECULIARITIES.


BERRIDGE MANUFACTURING COMPANY SHALL BE HELD HARMLESS FROM ANY AND ALL CLAIMS ARISING FROM LACK OF WATERTIGHTNESS AS A RESULT OF FOLLOWING THESE RECOMMENDED DETAILS. ENSURING WATERTIGHTNESS ON ANY GIVEN PROJECT IS THE FUNCTION OF THE INSTALLER. THE ARCHITECT/GENERAL CONTRACTOR/INSTALLER MUST ACCEPT THE RESPONSIBILITY TO ADAPT THESE DETAILS TO MEET PARTICULAR BUILDING REQUIREMENTS AND TO ASSURE ADEQUATE WATERTIGHTNESS.


THE INSTALLER CAN VIRTUALLY ASSURE WATERTIGHTNESS IF THESE FLASHING DETAILS HAVE BEEN PROPERLY ADAPTED, ADEQUATE LAPS HAVE BEEN PROVIDED, CORRECT TYPE OF SEALANT USED, ALL JOINTS ADEQUATELY CAULKED, AND PROFESSIONAL WORKMANSHIP EMPLOYED.

BERRIDGE FISH SCALE SHINGLE

HISTORICAL PRODUCT INSTALLED OVER SOLID SHEATHING; FOR GABLE, SIDEWALL, FASCIA OR MANSARD (80 DEGREE + SLOPE)


EACH SHINGLE IS STAMPED WITH TWO SCALE MODULES PER SHINGLE. THE EXPOSURE TO THE WEATHER SHALL BE 8–1/2" BY 11–1/2" PER SHINGLE.

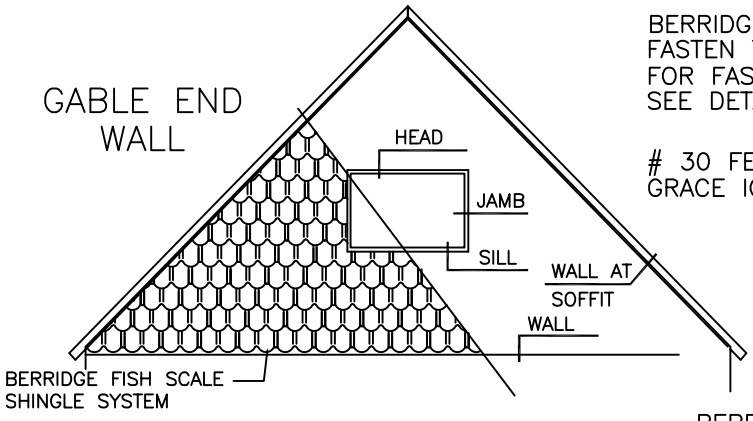

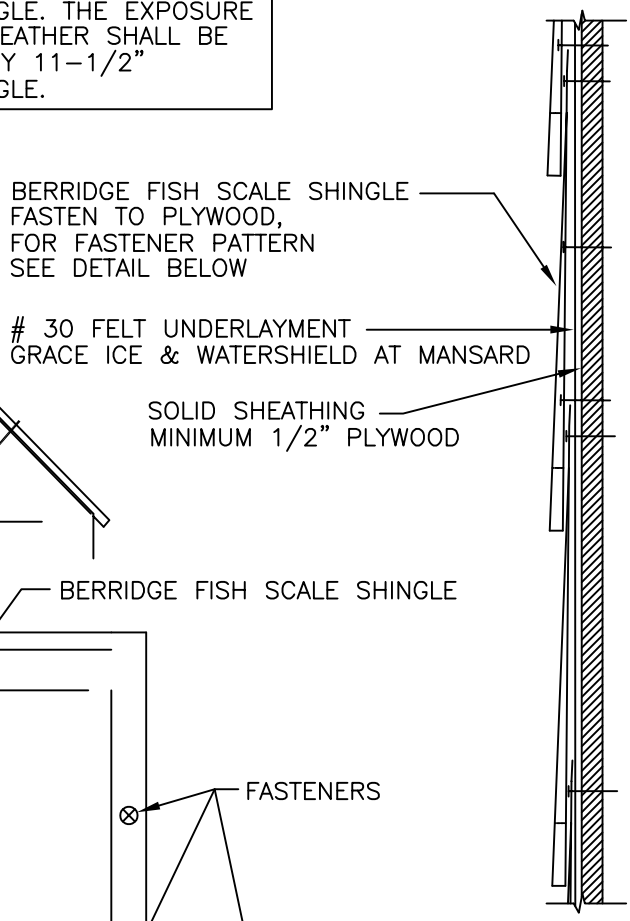

SECTION DETAIL

NOTE:
FASTENERS ARE TO BE LOCATED APPROXIMATELY AS SHOWN ON THE DRAWINGS

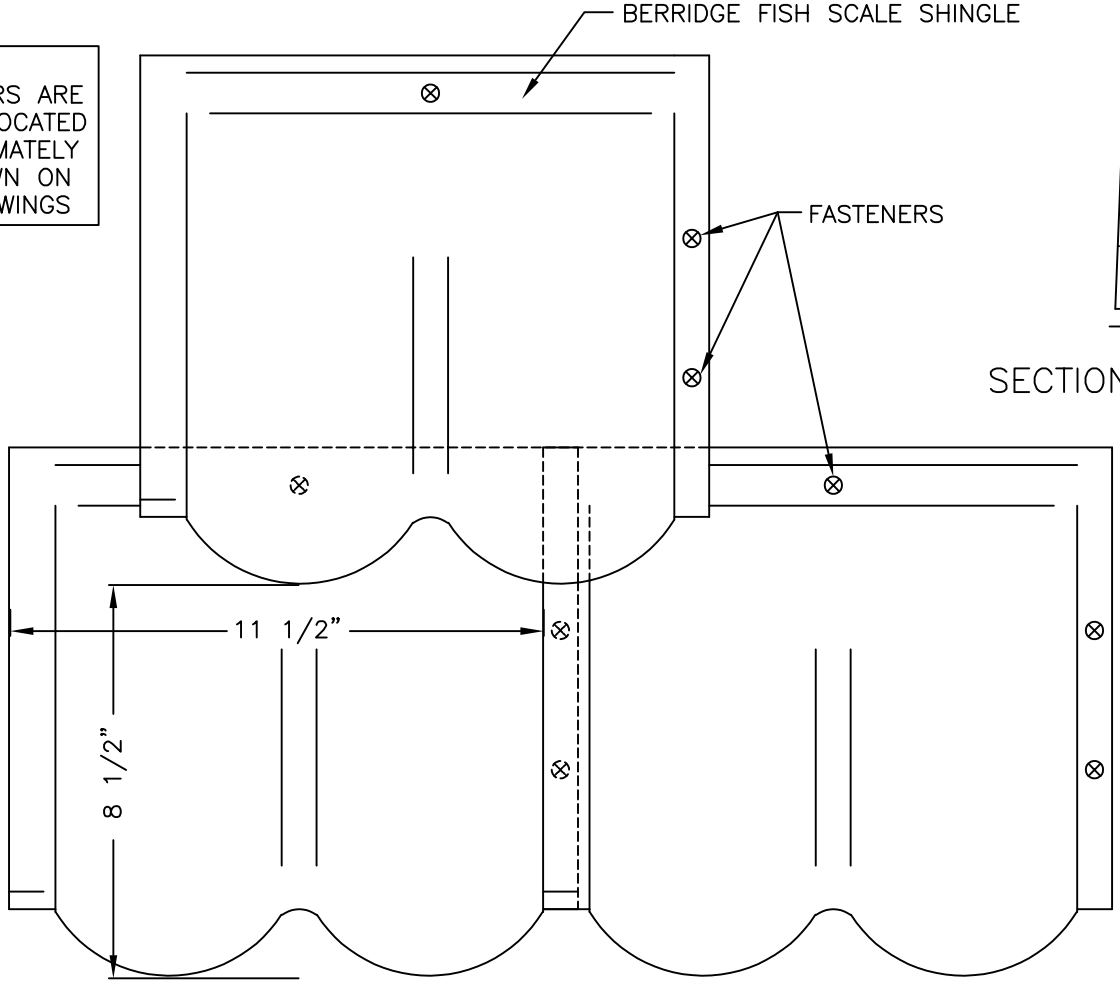

FISH SCALE SHINGLE DETAIL

Berridge Manufacturing Company

Roofs of Distinction


SHINGLE OVERVIEW

FISH SCALE SHINGLE


DATE: 03/22/08

PAGE\FILE

FSS-I

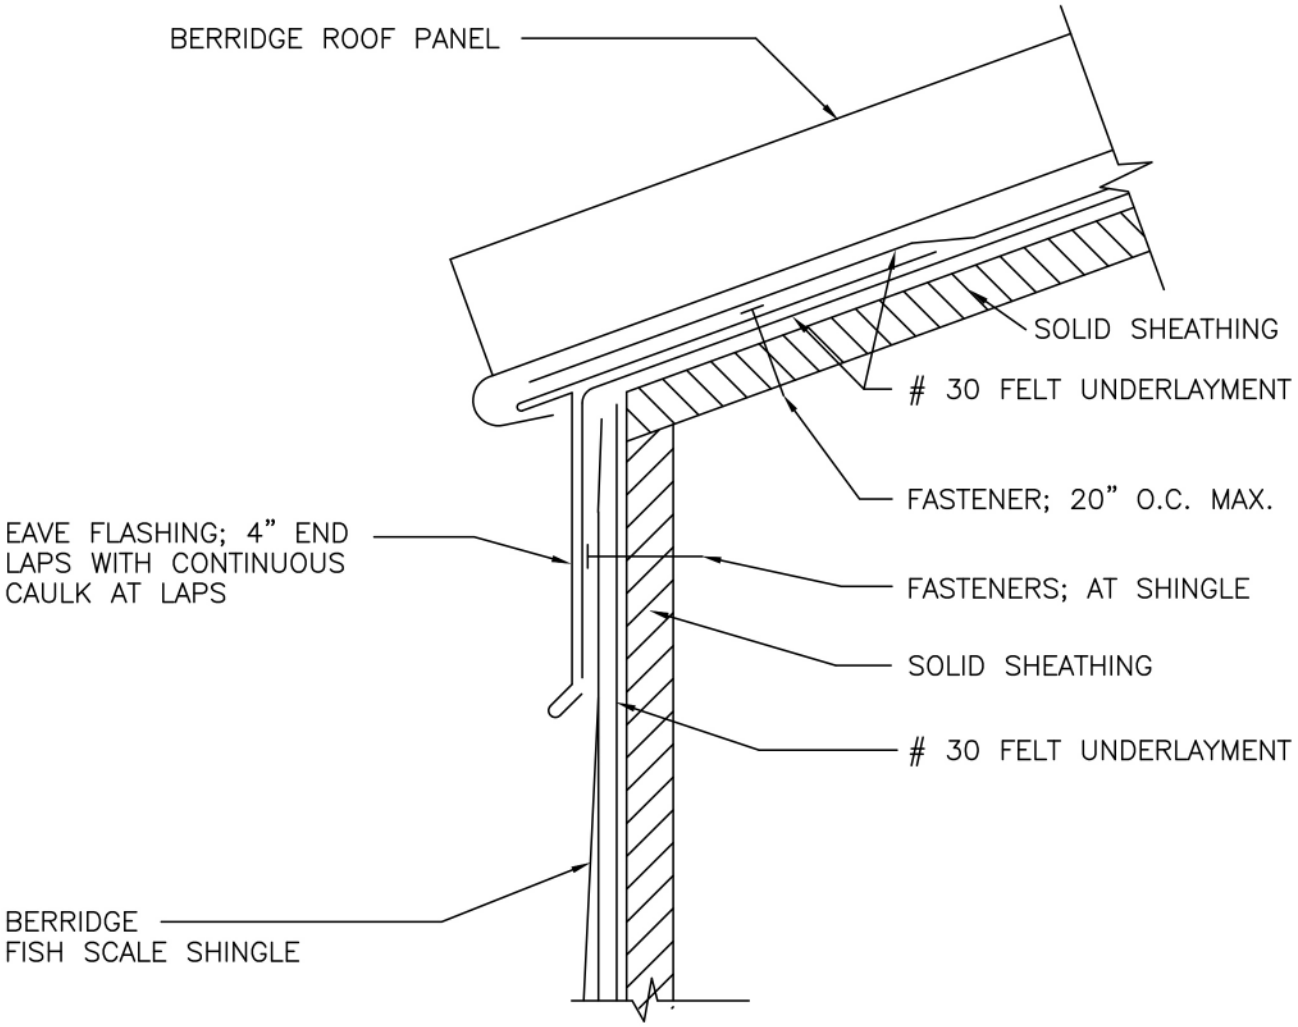

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

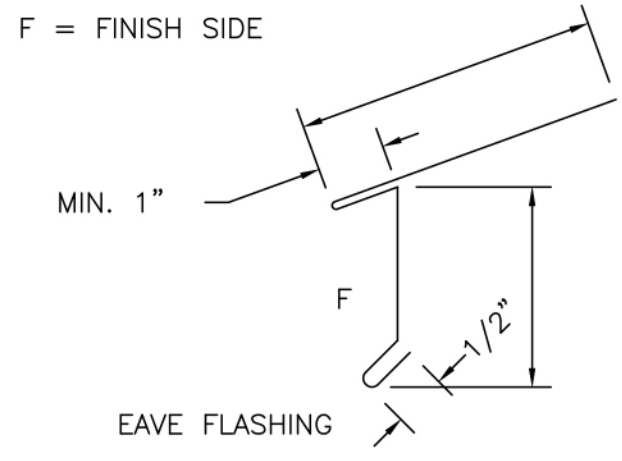


Berridge Manufacturing Company
Roofs of Distinction

FASCIA DETAIL BELOW EAVE

FISH SCALE SHINGLE


DATE: 03/22/08

PAGE\FILE
FSS-10

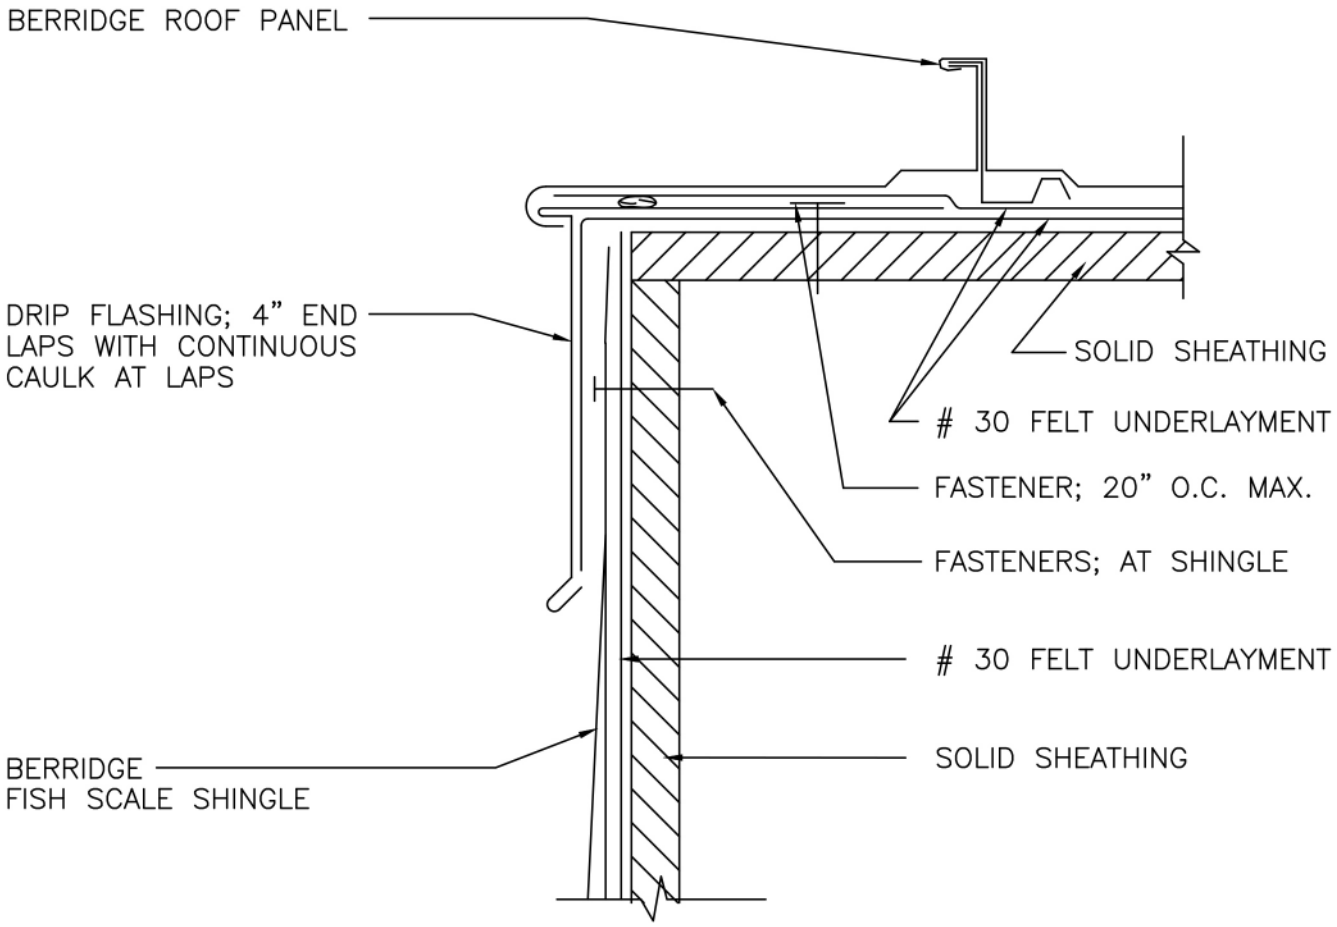

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

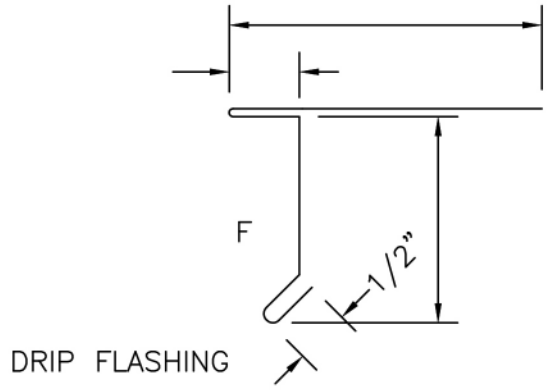


DATE: 03/22/08

FASCIA DETAIL BELOW GABLE

PAGE\FILE
FSS-II


FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

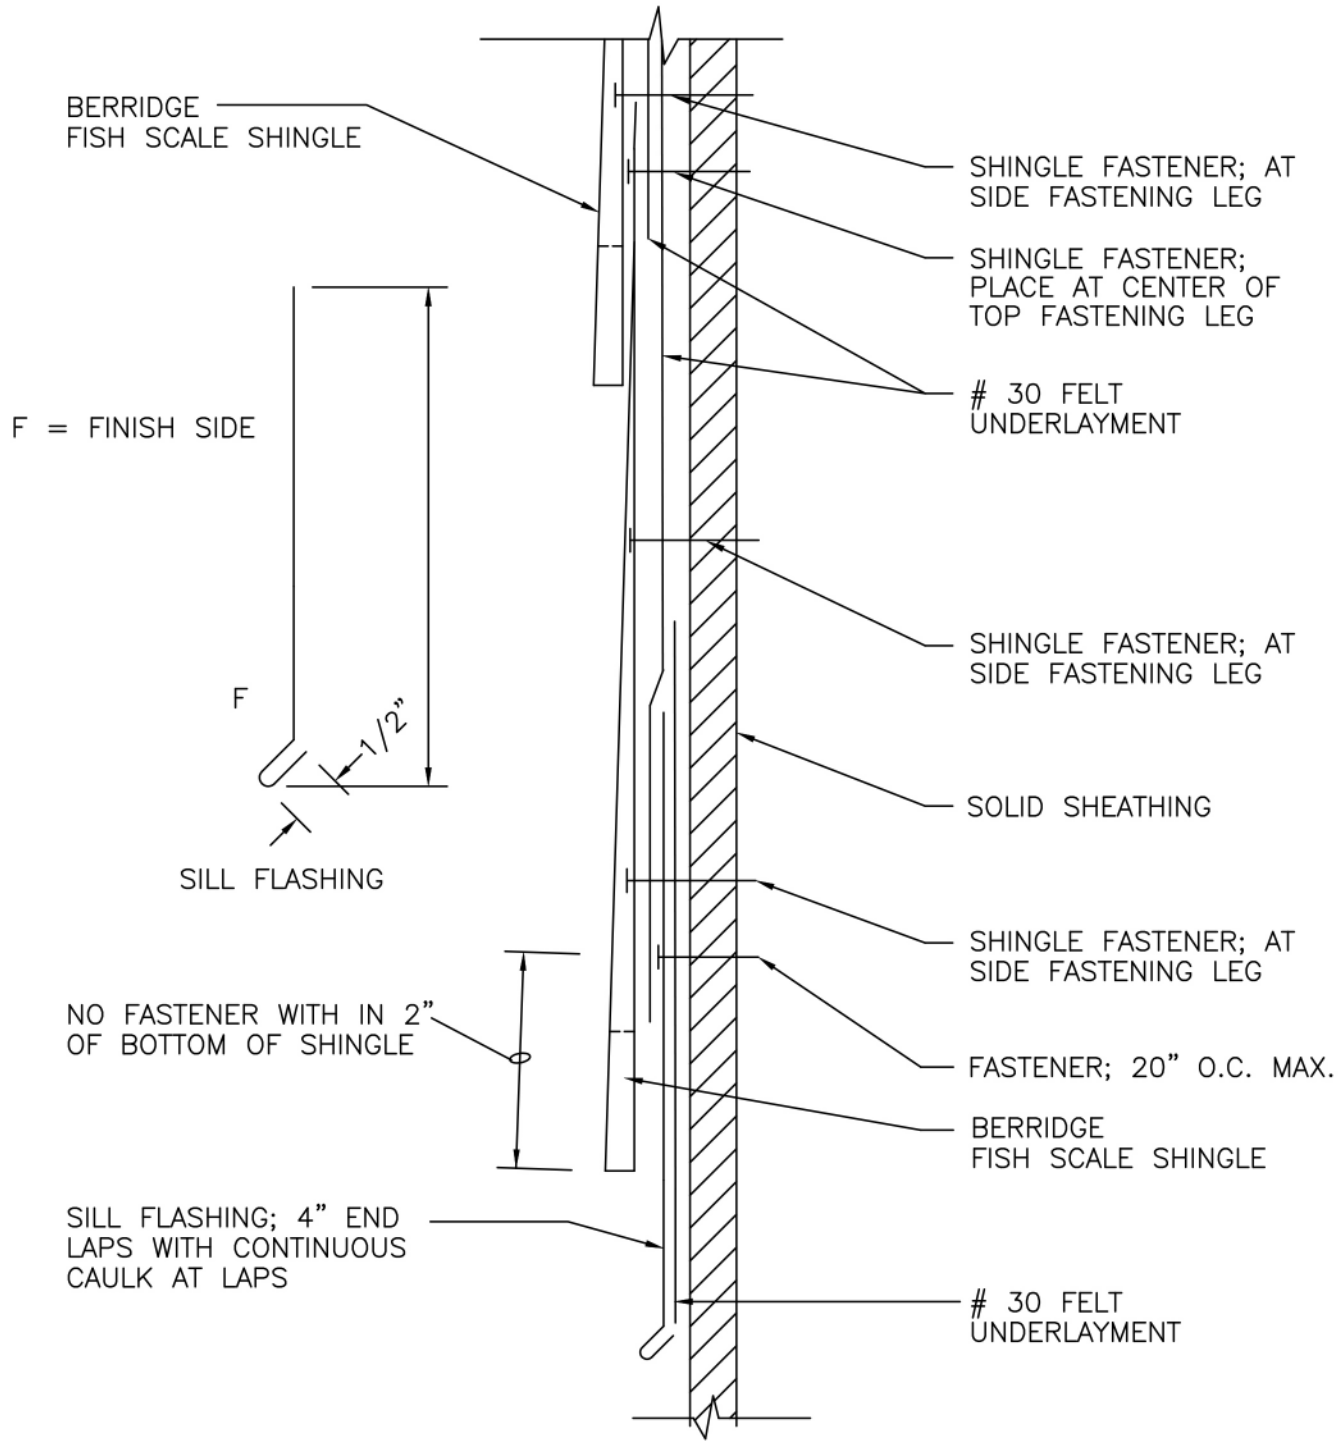


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

BERRIDGE Roofs of Distinction Berridge Manufacturing Company	FASCIA SILL	DATE: 03/22/08
	FISH SCALE SHINGLE	PAGE\FILE FSS-20

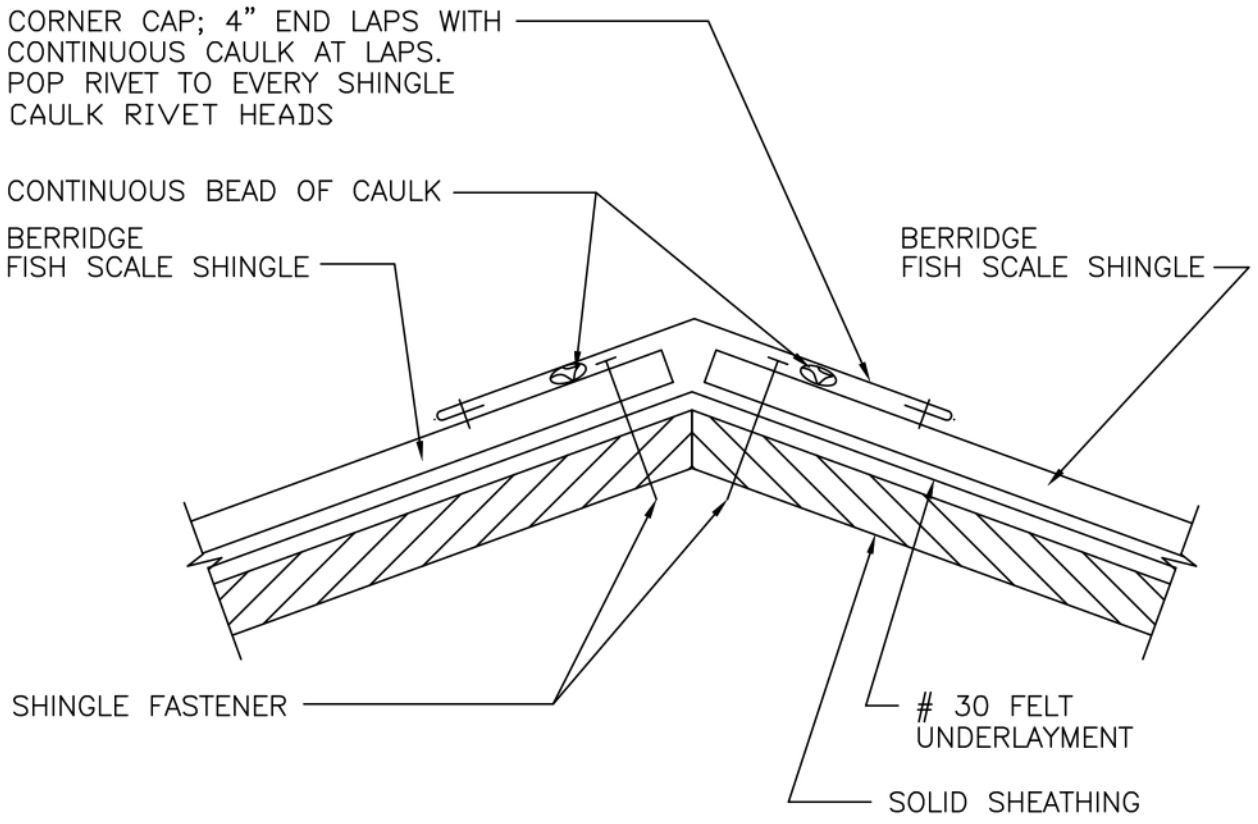

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

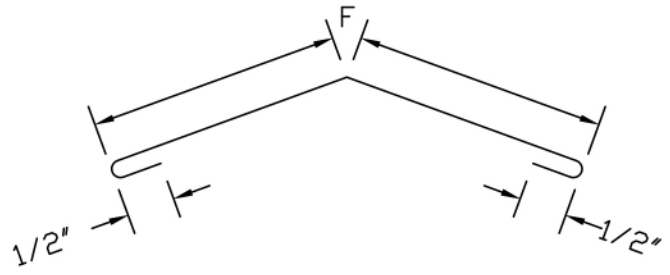

CORNER CAP


DATE: 03/22/08

FASCIA OUTSIDE CORNER DETAIL

PAGE\FILE
FSS-21


FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

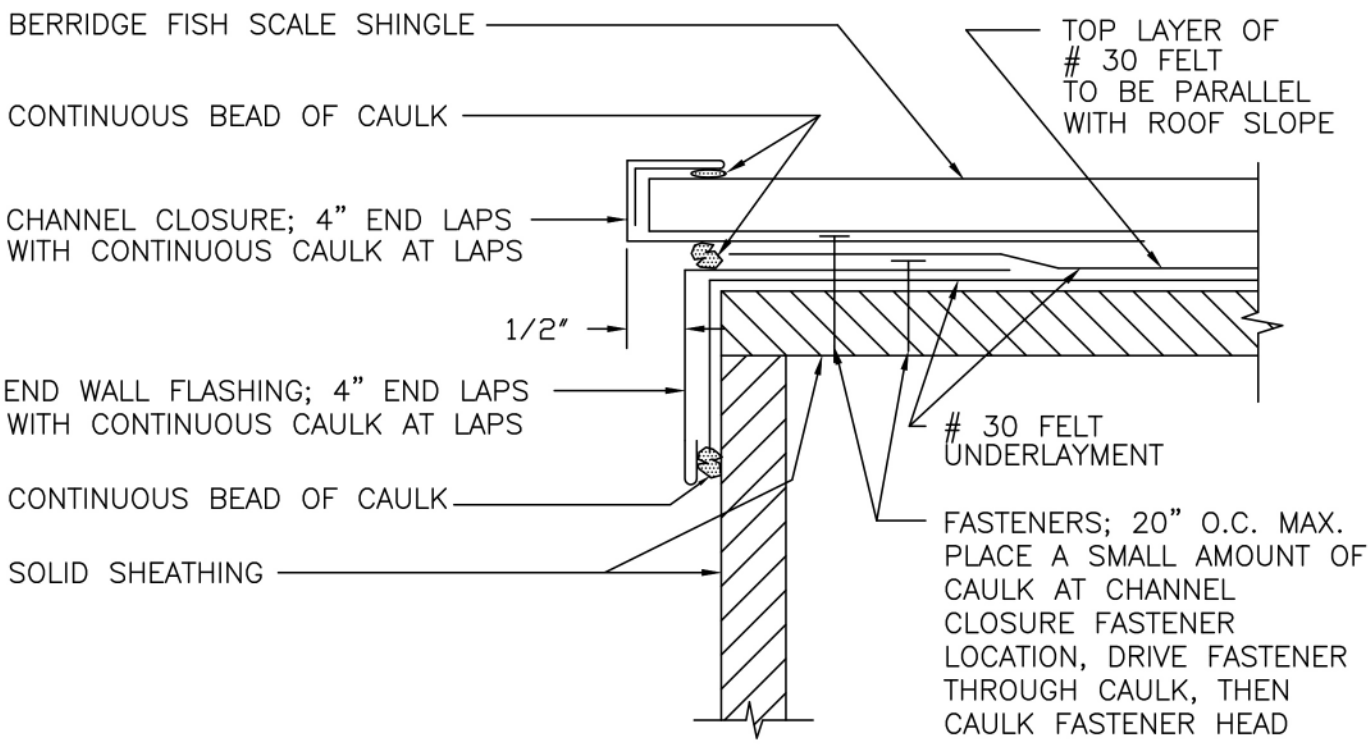


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

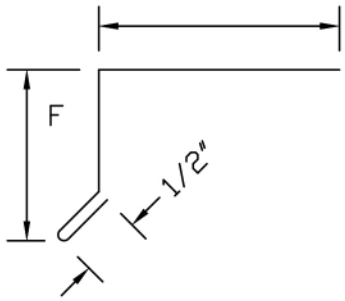

GABLE FLASHING

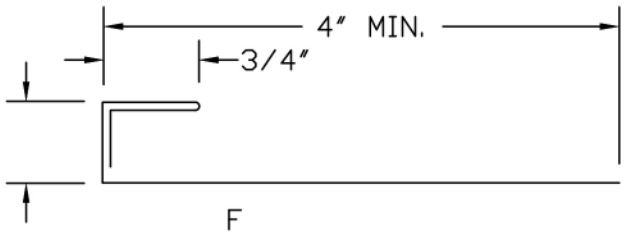

CHANNEL CLOSURE

Berridge Manufacturing Company

Roofs of Distinction


FASCIA END WALL

FISH SCALE SHINGLE

DATE: 03/22/08

PAGE\FILE

FSS-22

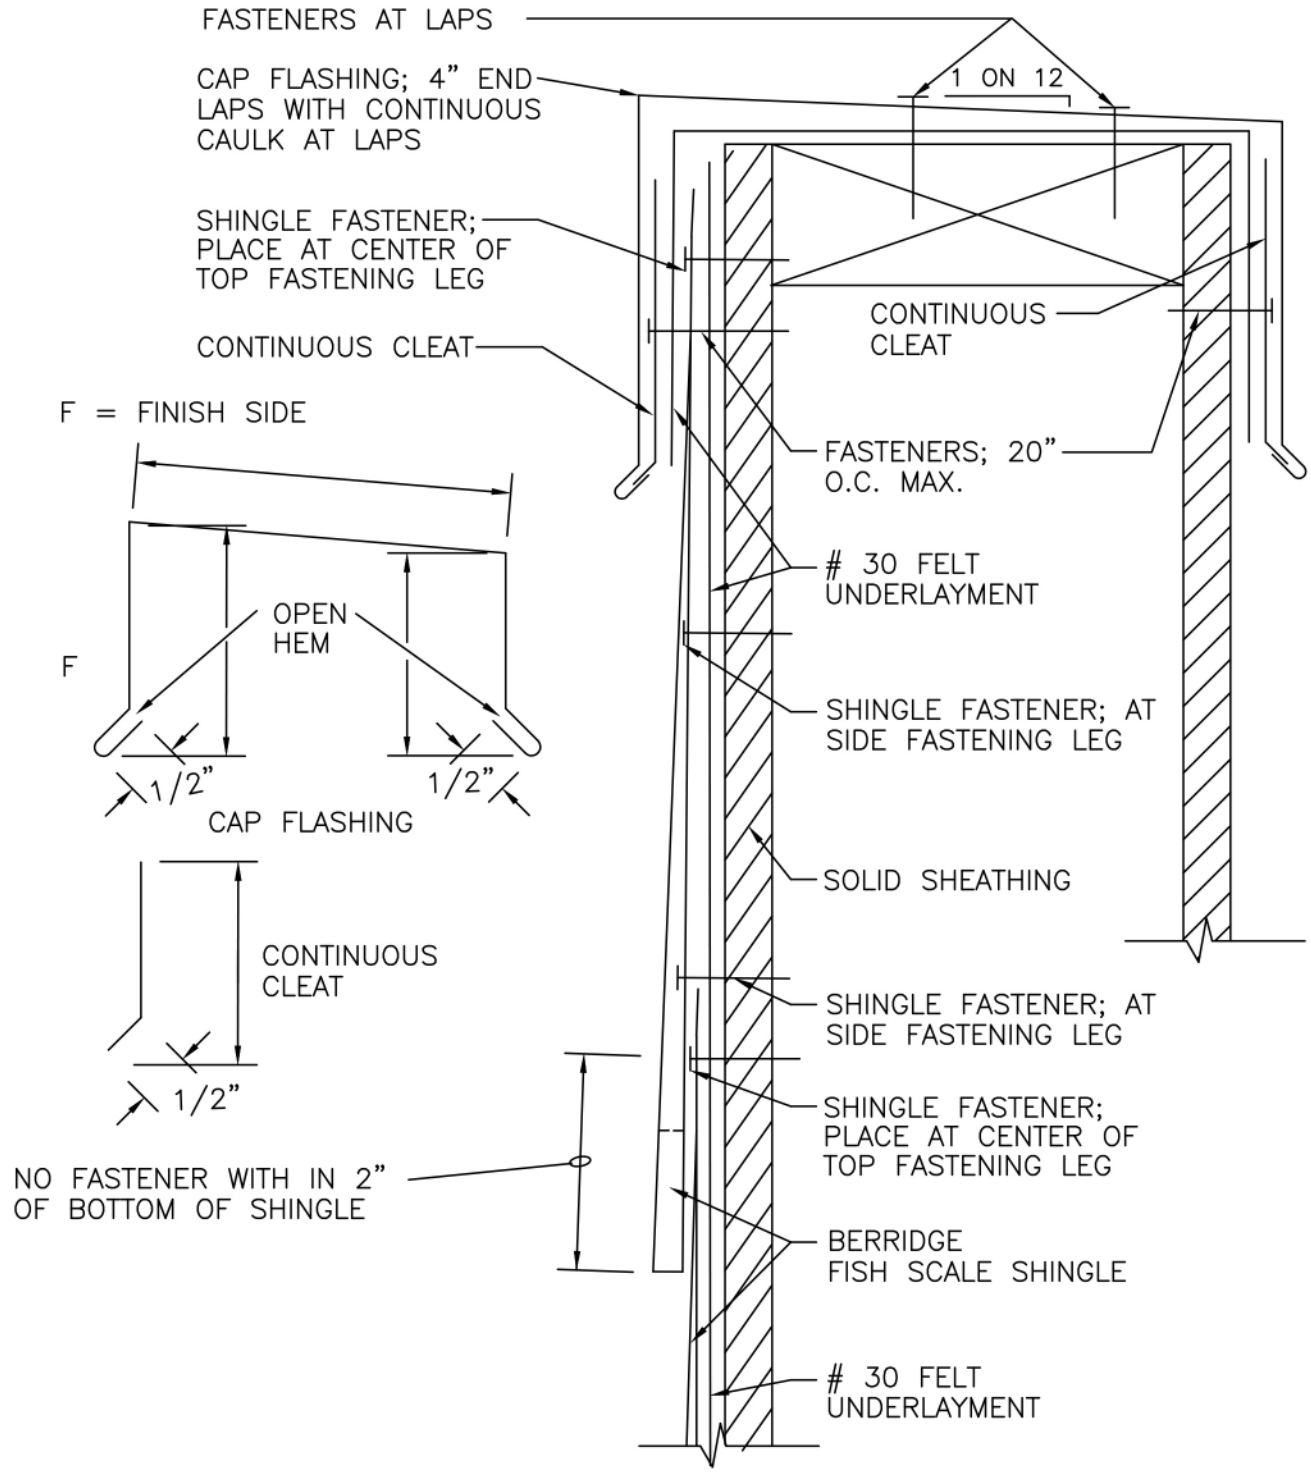

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.


DATE: 03/22/08

FASCIA AT PARAPET

PAGE\FILE
FSS-23


FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

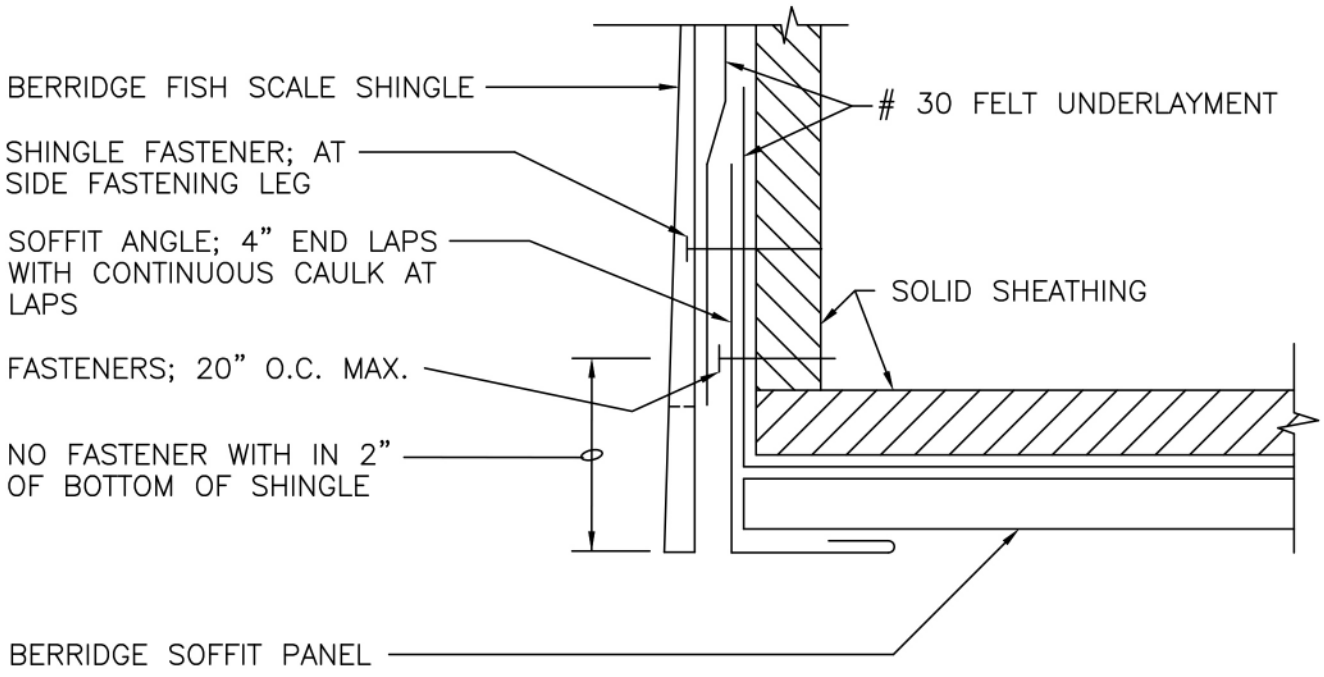

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

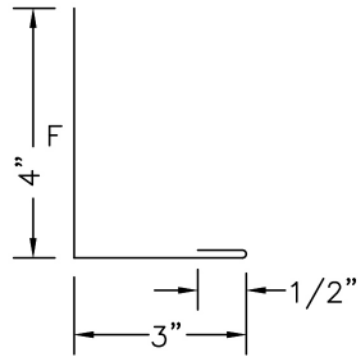

SOFFIT ANGLE

Berridge Manufacturing Company

Roofs of Distinction


FASCIA/SOFFIT DETAIL

DATE: 03/22/08

FISH SCALE SHINGLE


PAGE\FILE

FSS-30

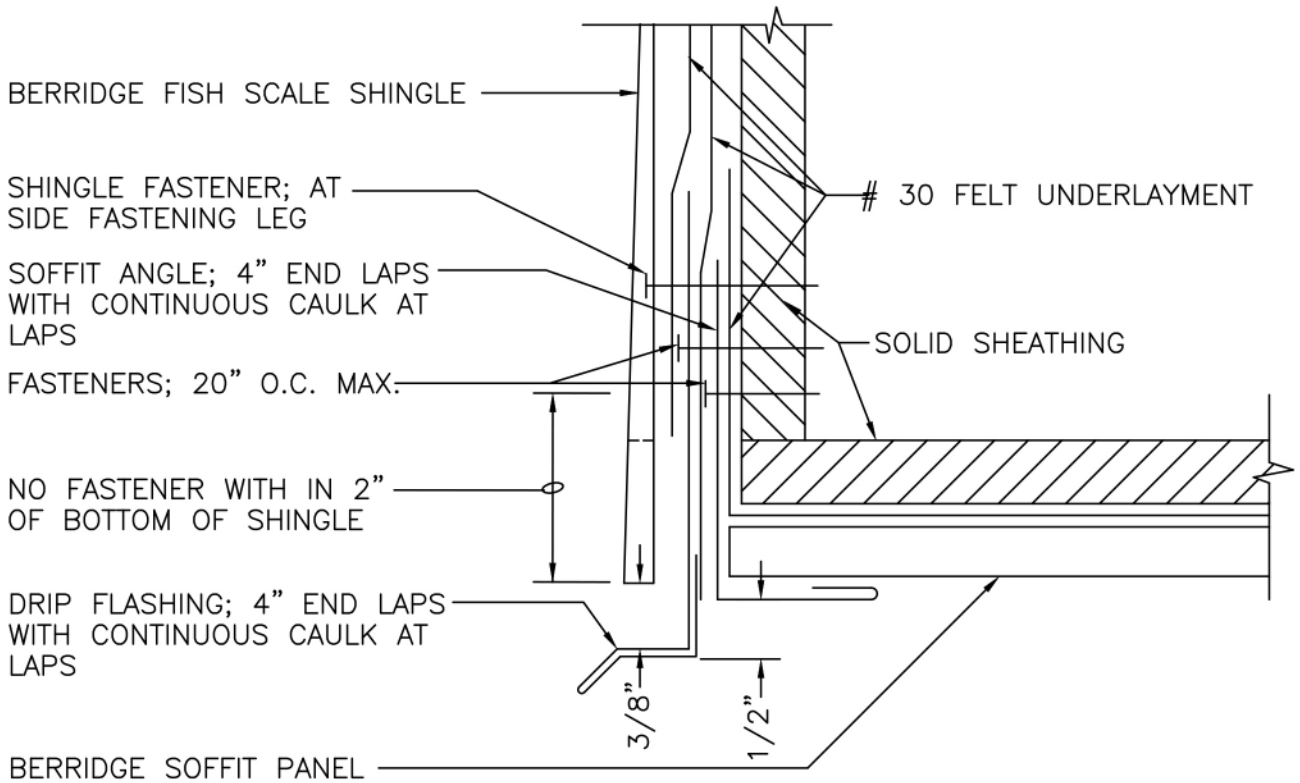


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

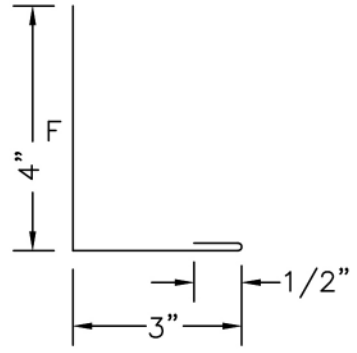

SOFFIT ANGLE

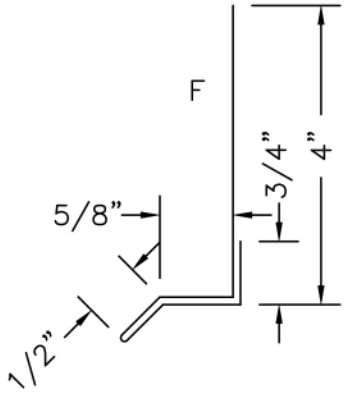

DRIP FLASHING


DATE: 03/22/08

PAGE\FILE
FSS-31

FASCIA/SOFFIT DETAIL


FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

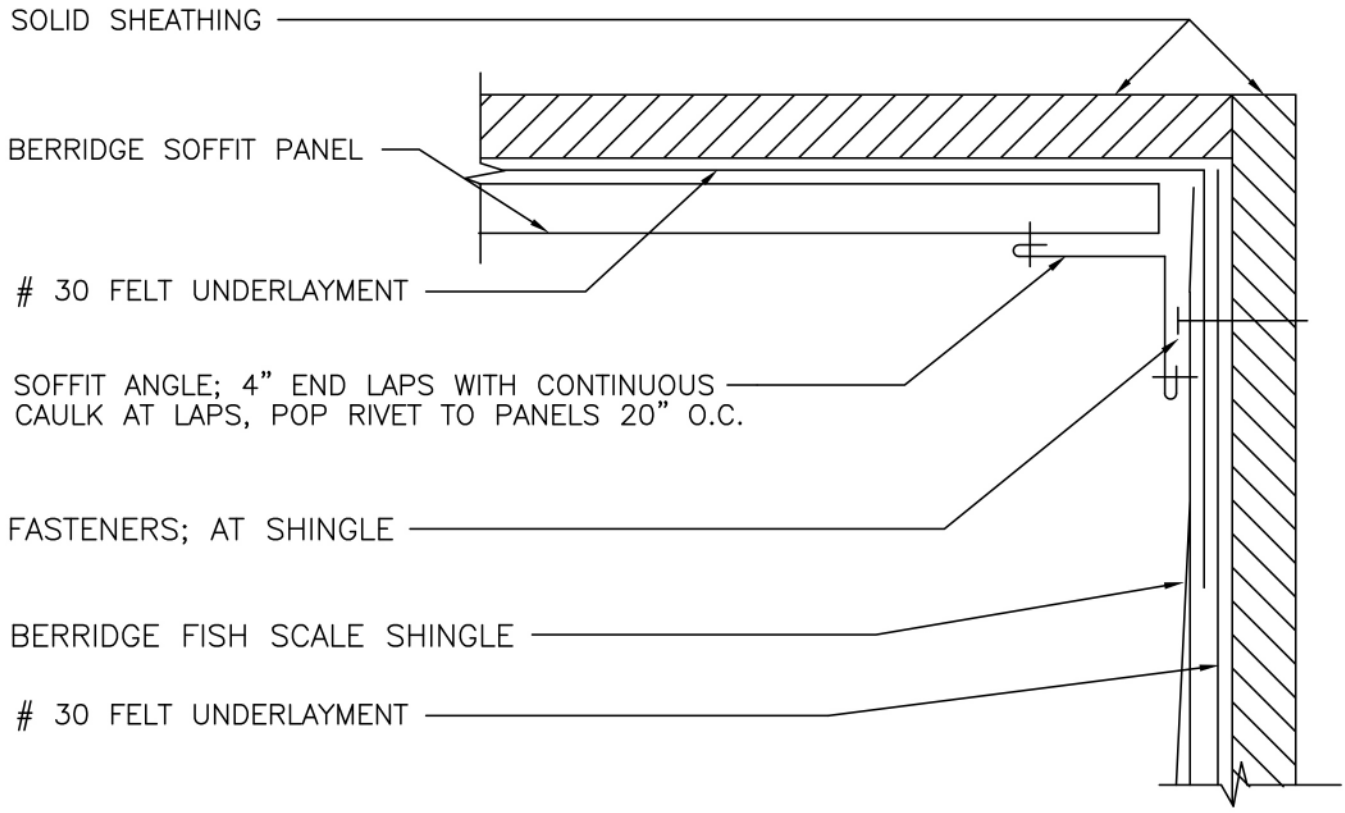

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

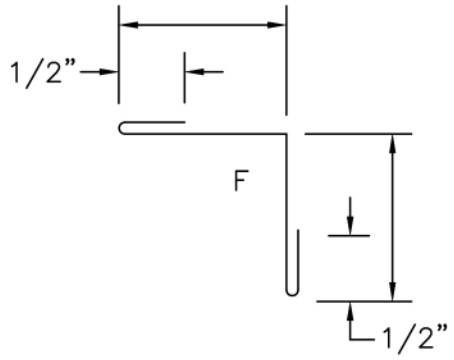

SOFFIT ANGLE

Berridge Manufacturing Company

Roofs of Distinction


WALL/SOFFIT DETAIL

DATE: 03/22/08

FISH SCALE SHINGLE


PAGE\FILE

FSS-32

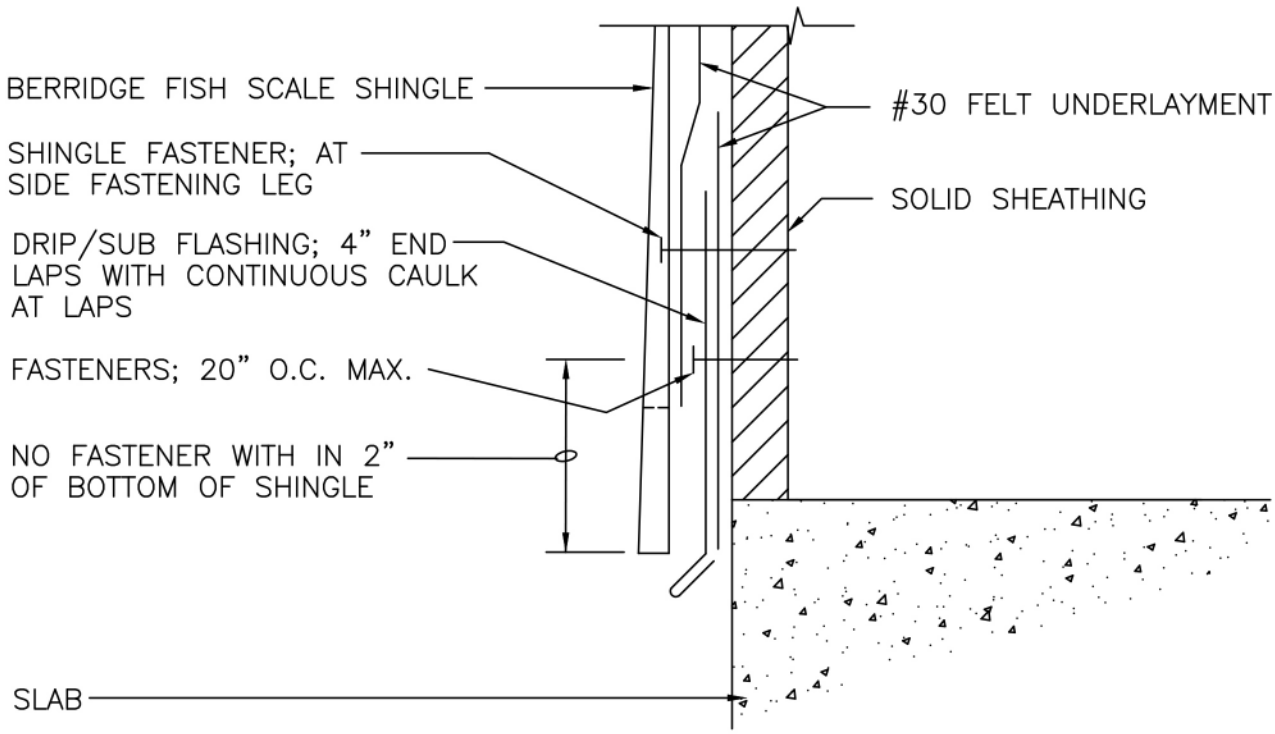

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

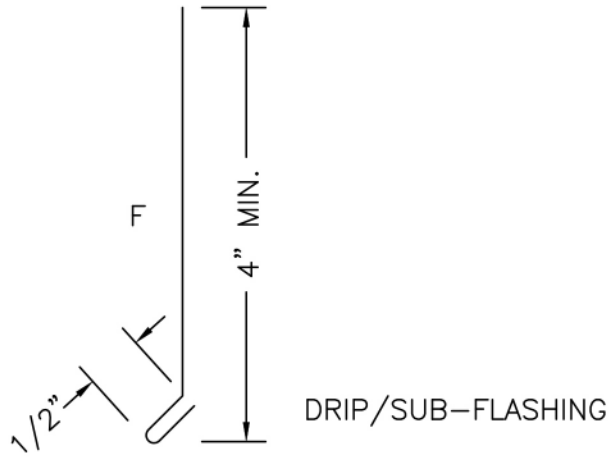

Berridge Manufacturing Company

Roofs of Distinction


SILL AT SLAB DETAIL

DATE: 03/22/08

FISH SCALE SHINGLE


PAGE\FILE

FSS-40

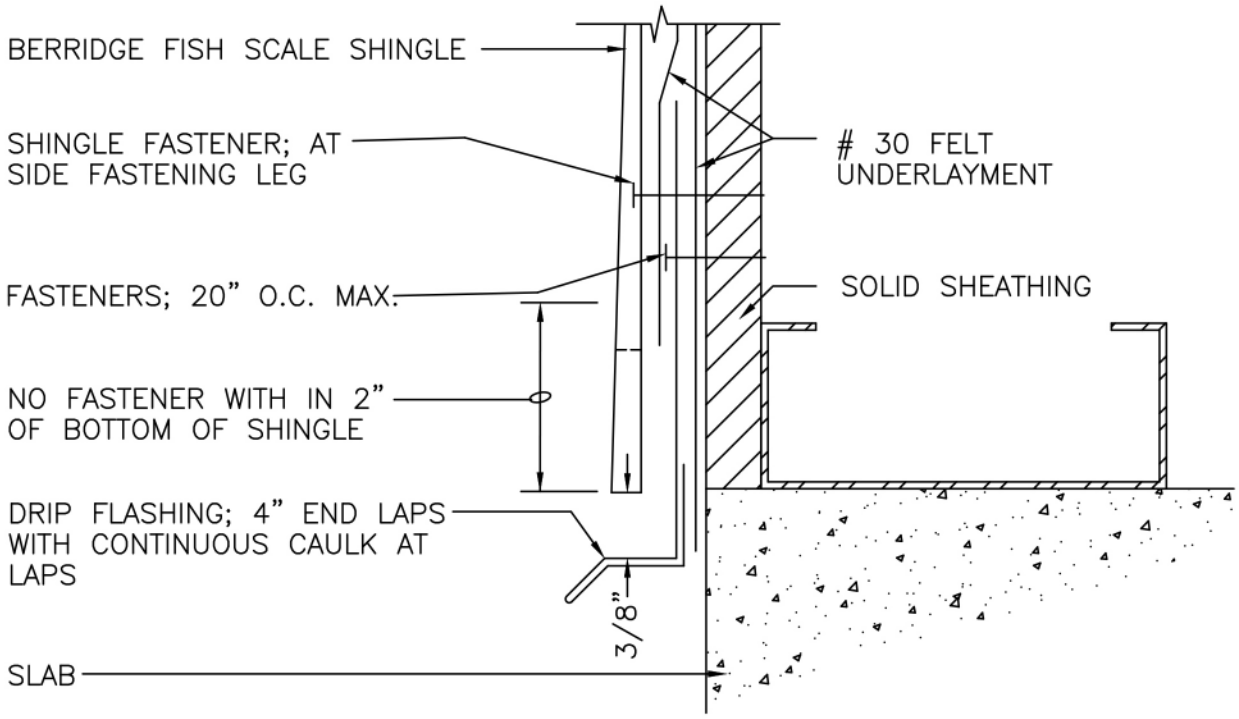

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

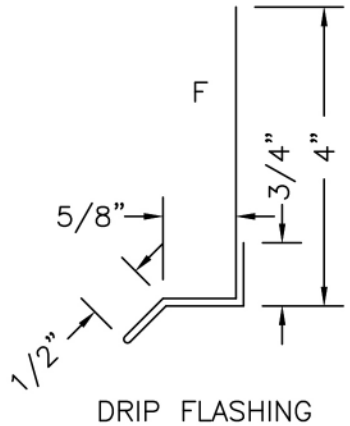

DRIP FLASHING


DATE: 03/22/08

PAGE\FILE
FSS-41

SILL AT SLAB DETAIL


FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

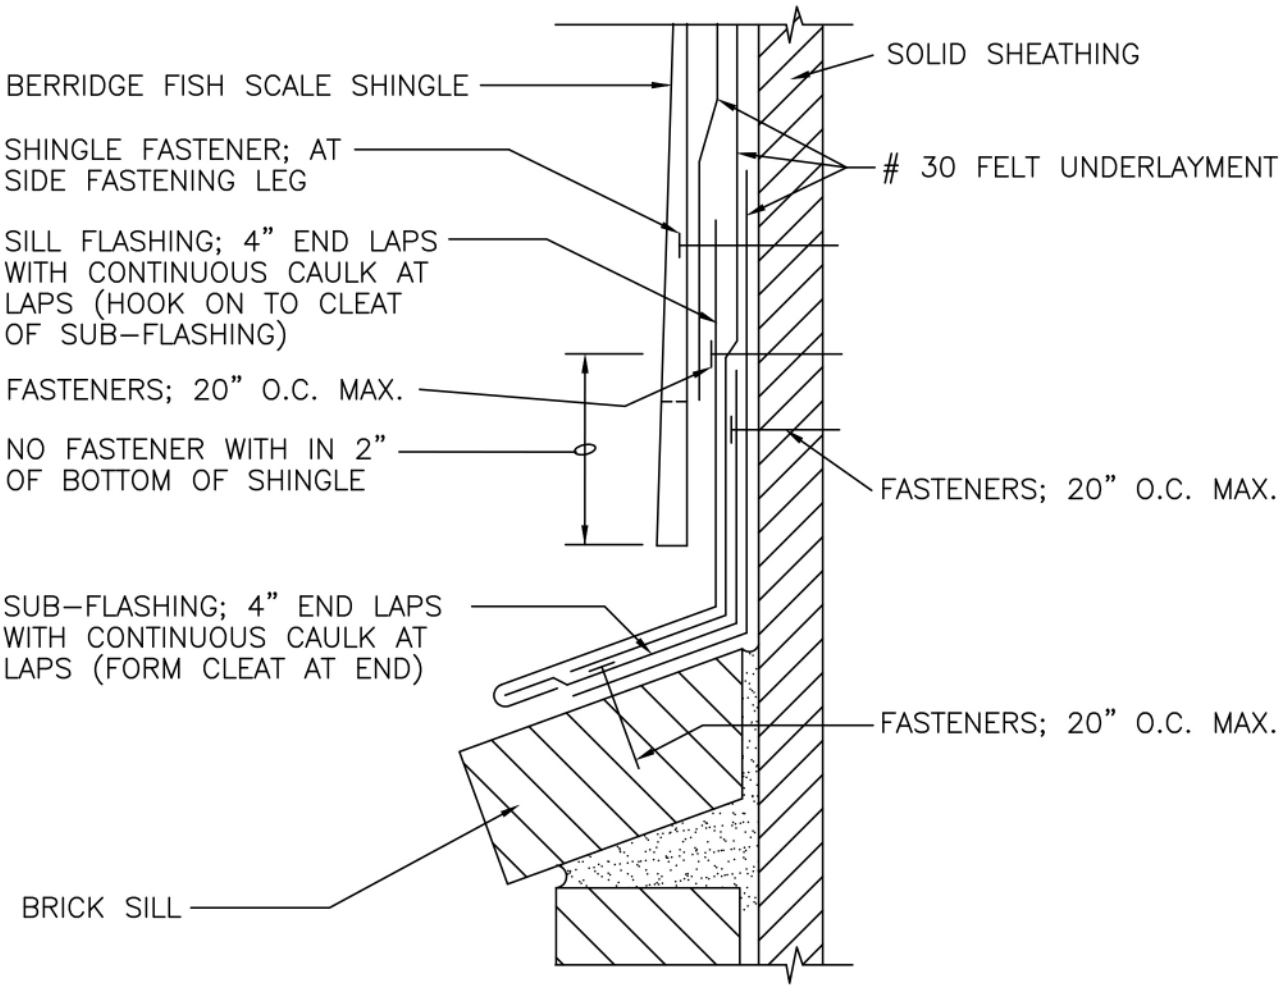


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

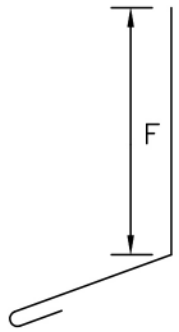

SILL FLASHING



SUB-FLASHING

Berridge Manufacturing Company

Roofs of Distinction


SILL AT BRICK DETAIL

DATE: 03/22/08


FISH SCALE SHINGLE

PAGE\FILE

FSS-42

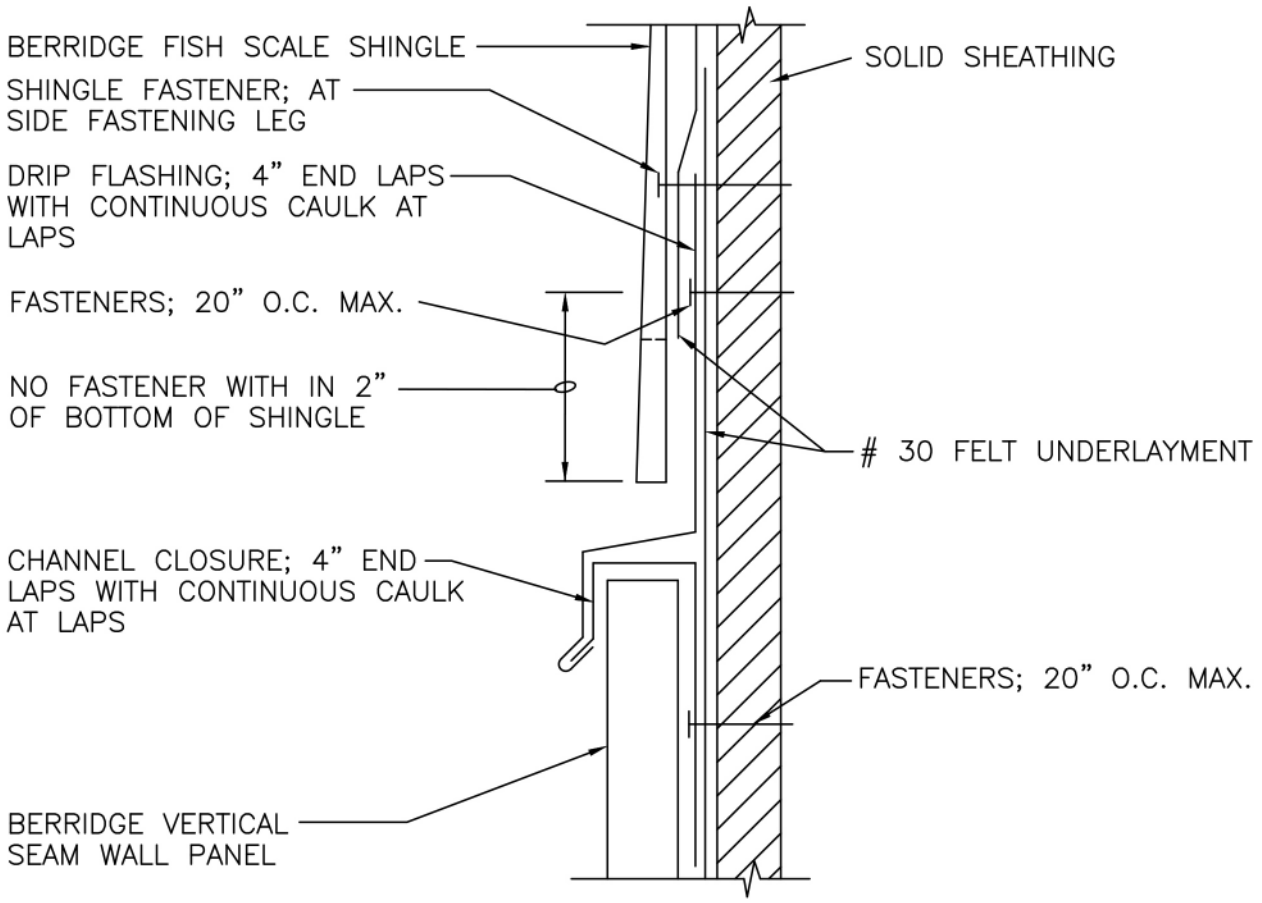


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

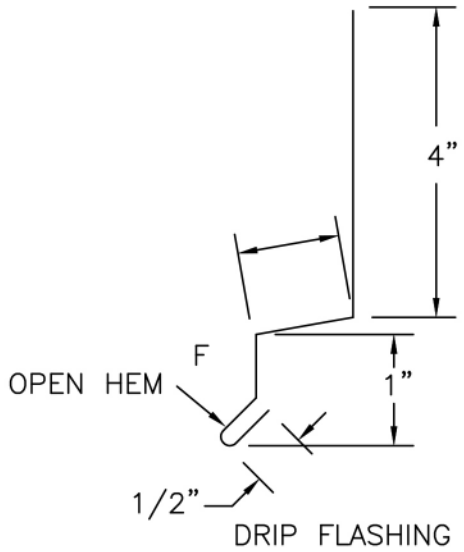

DRIP FLASHING

F = FINISH SIDE

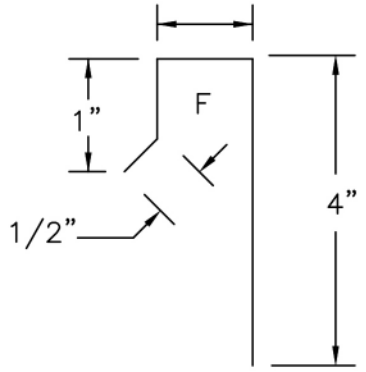

CHANNEL CLOSURE


DATE: 03/22/08

SILL AT VERTICAL PANEL

PAGE\FILE
FSS-43


FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

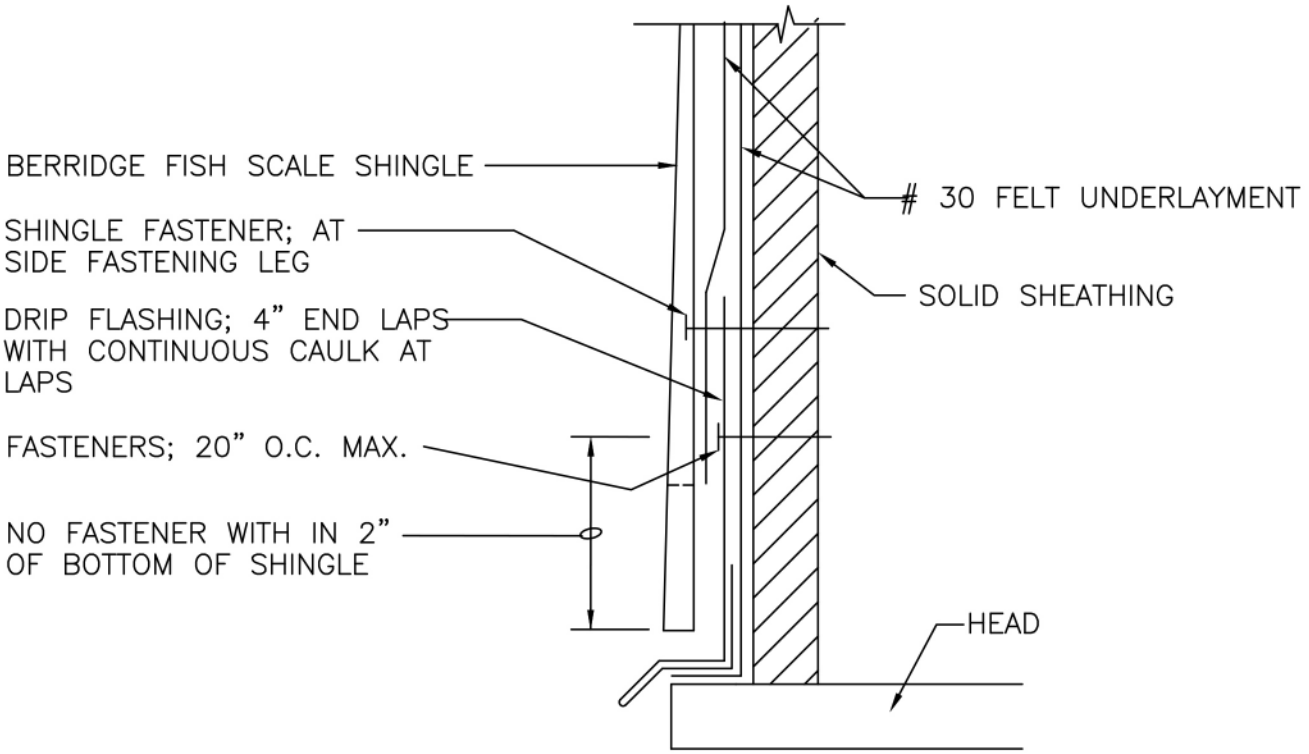

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

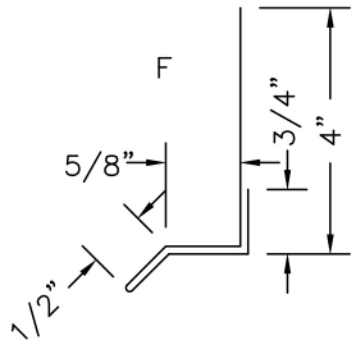

DRIP FLASHING


Berridge Manufacturing Company
Roofs of Distinction

HEADER DETAIL

FISH SCALE SHINGLE


DATE: 03/22/08

PAGE\FILE
FSS-50

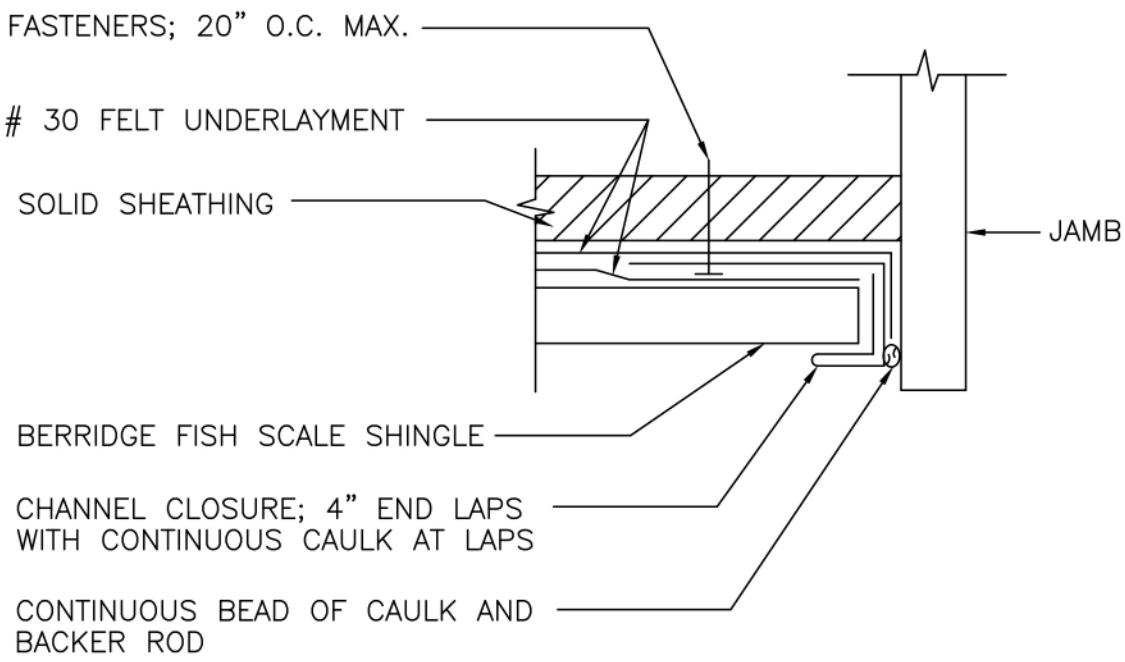

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

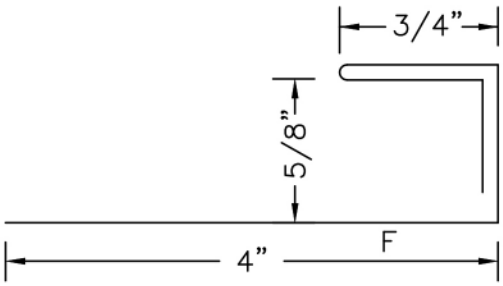

CHANNEL CLOSURE


DATE: 03/22/08

PAGE\FILE
FSS-51

WINDOW/DOOR JAMB


FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

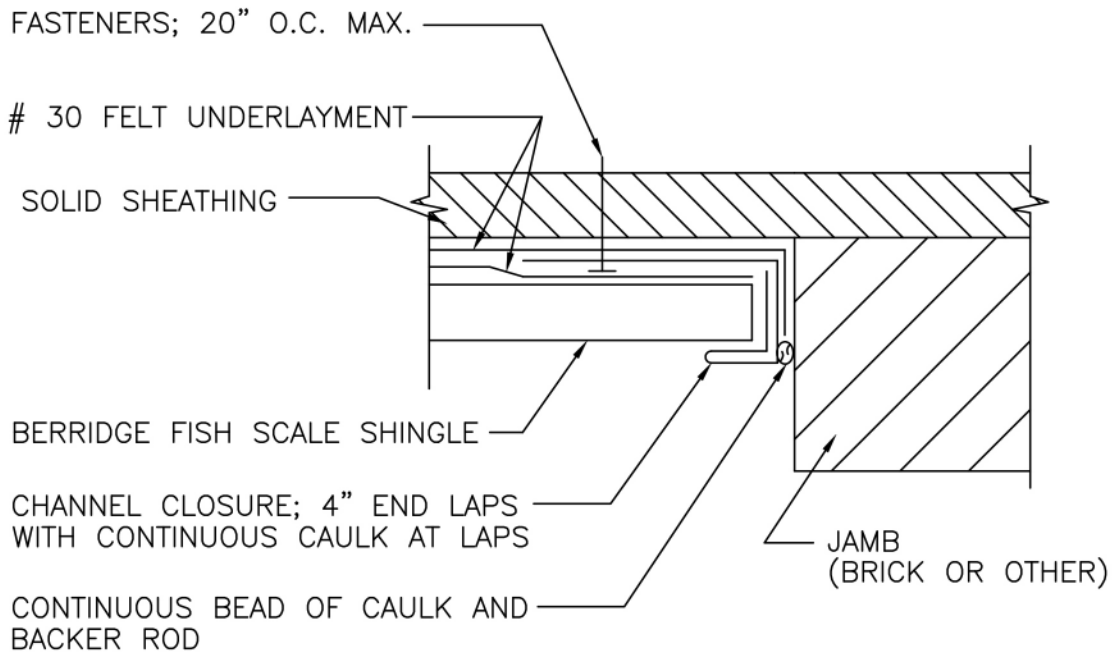

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

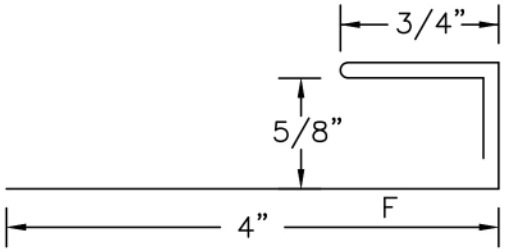

CHANNEL CLOSURE

Berridge Manufacturing Company

Roofs of Distinction


JAMB DETAIL

FISH SCALE SHINGLE

DATE: 03/22/08


PAGE\FILE

FSS-52

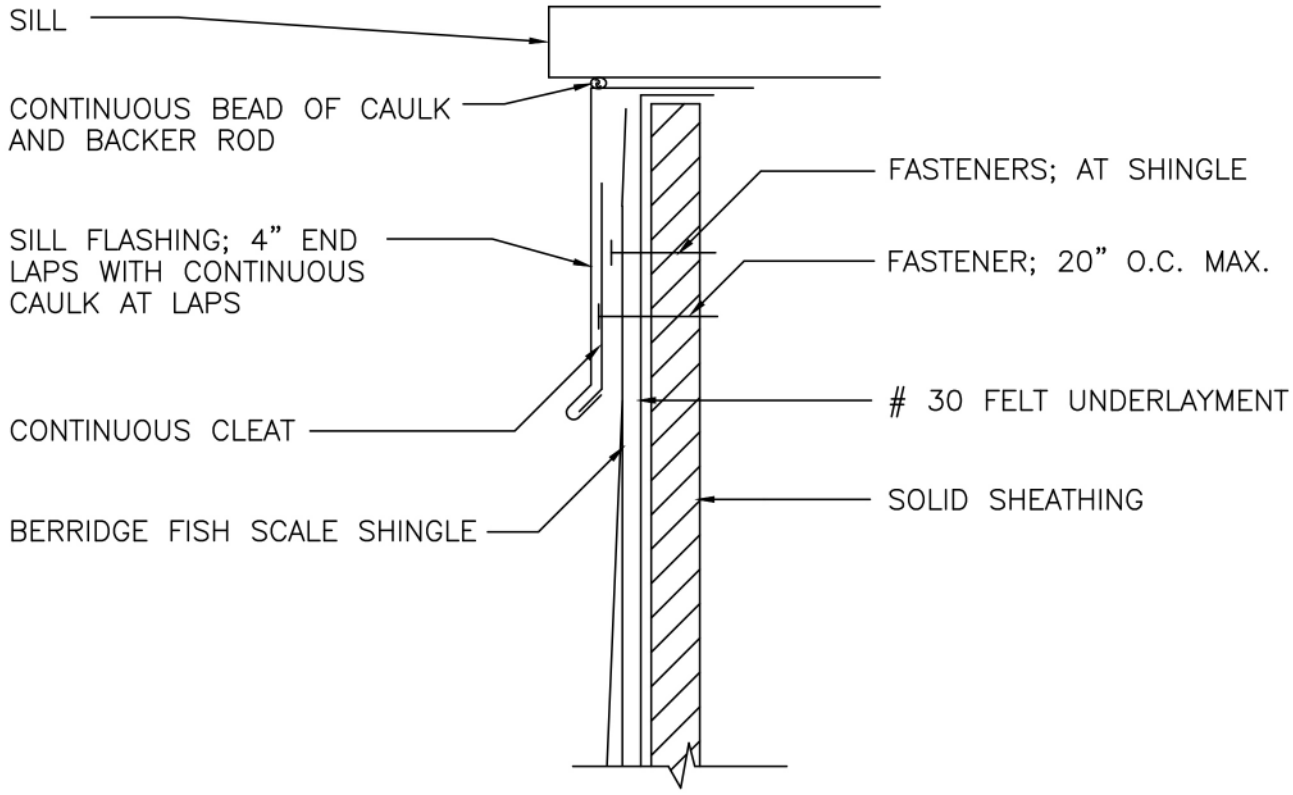


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

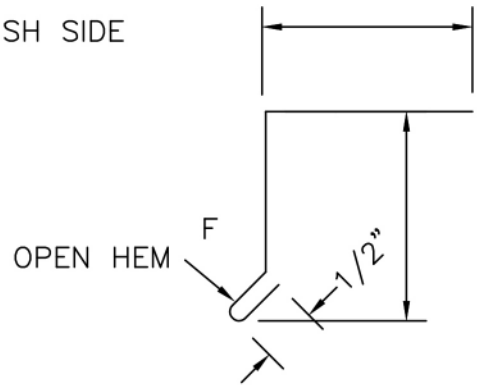

SILL FLASHING



CONTINUOUS CLEAT


DATE: 03/22/08

PAGE\FILE
FSS-53


SILL DETAIL

FISH SCALE SHINGLE


Berridge Manufacturing Company
Roofs of Distinction

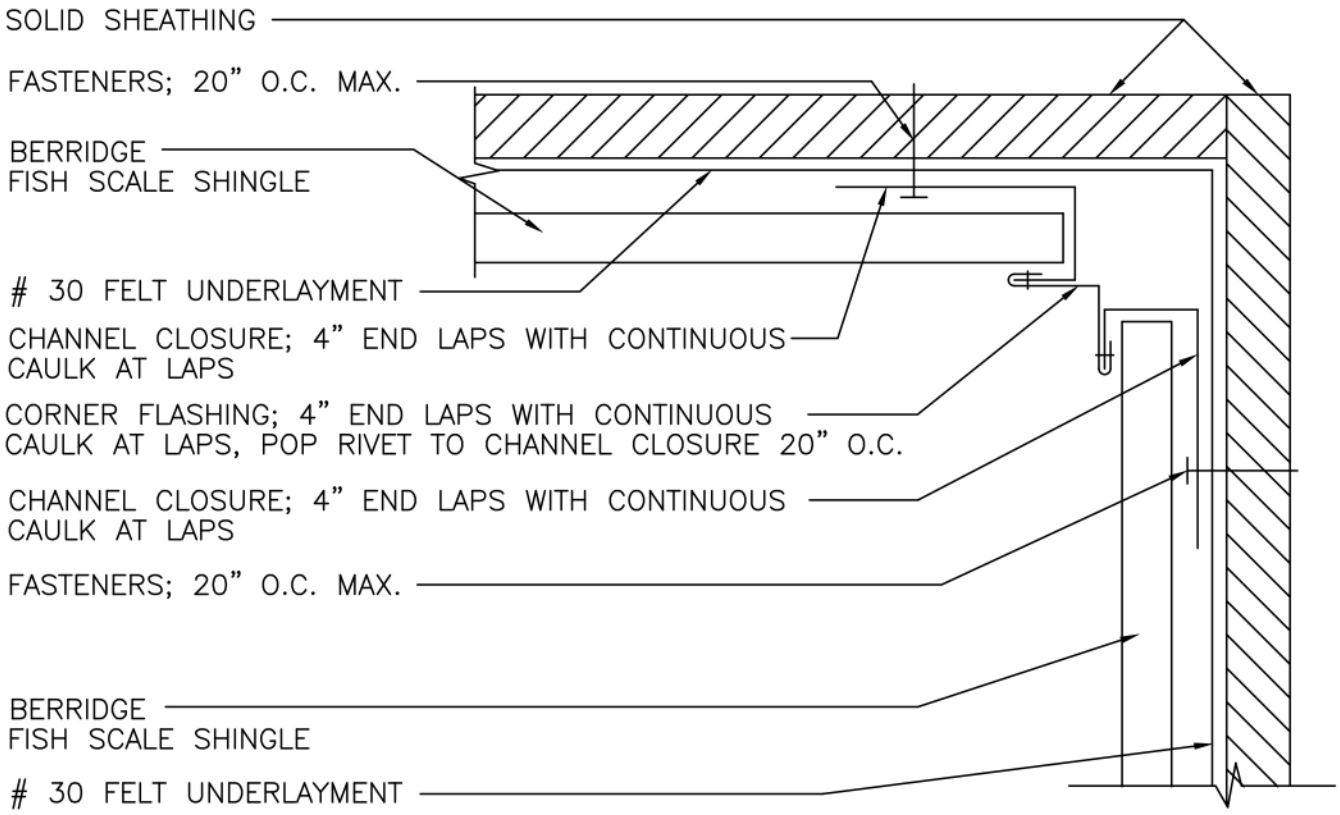

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

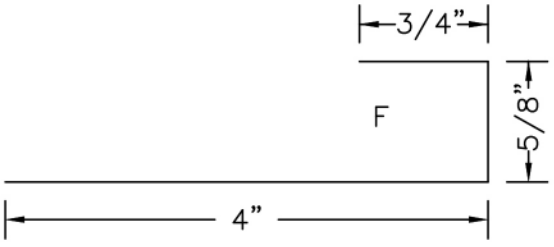

CHANNEL CLOSURE

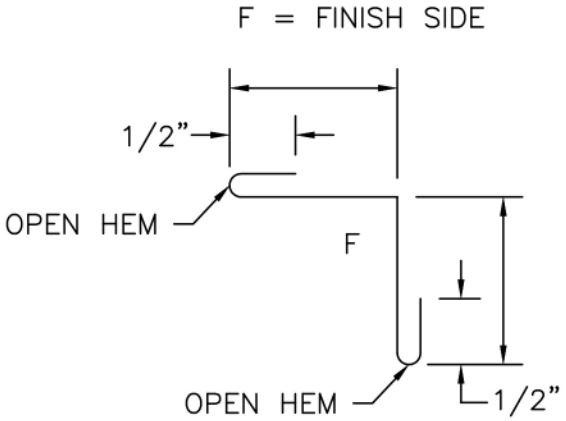

CORNER FLASHING

Berridge Manufacturing Company

Roofs of Distinction


INSIDE CORNER DETAIL

FISH SCALE SHINGLE

DATE: 03/22/08


PAGE\FILE

FSS-60

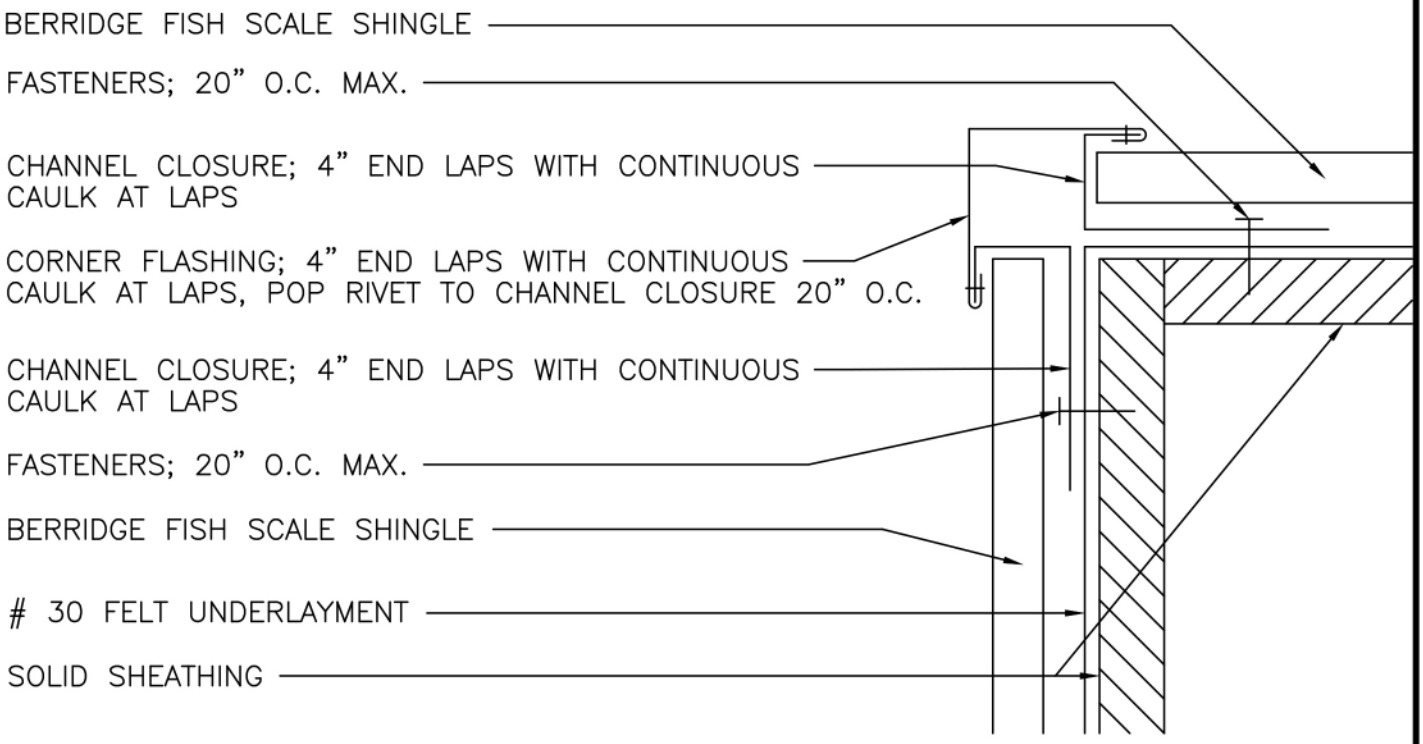


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

F = FINISH SIDE

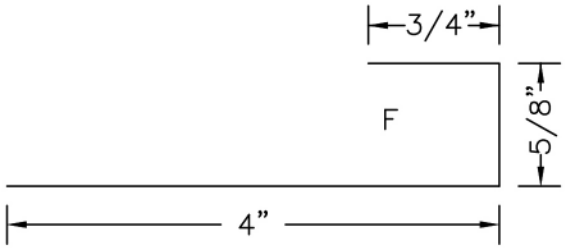

CHANNEL CLOSURE

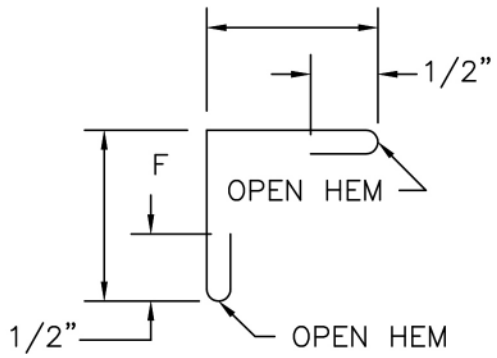

CORNER FLASHING


DATE: 03/22/08

OUTSIDE CORNER DETAIL


PAGE\FILE
FSS-61

FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

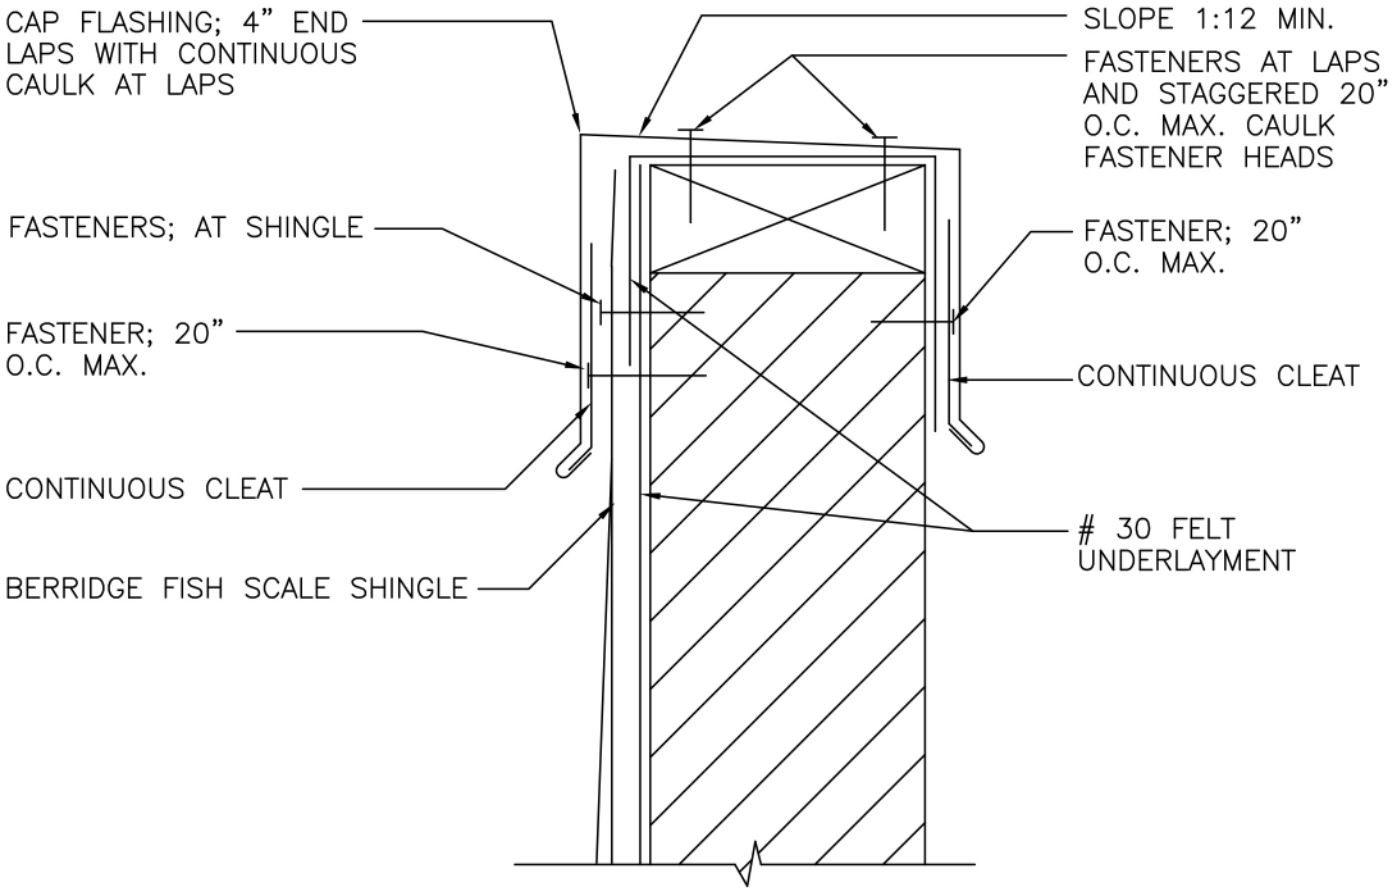

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

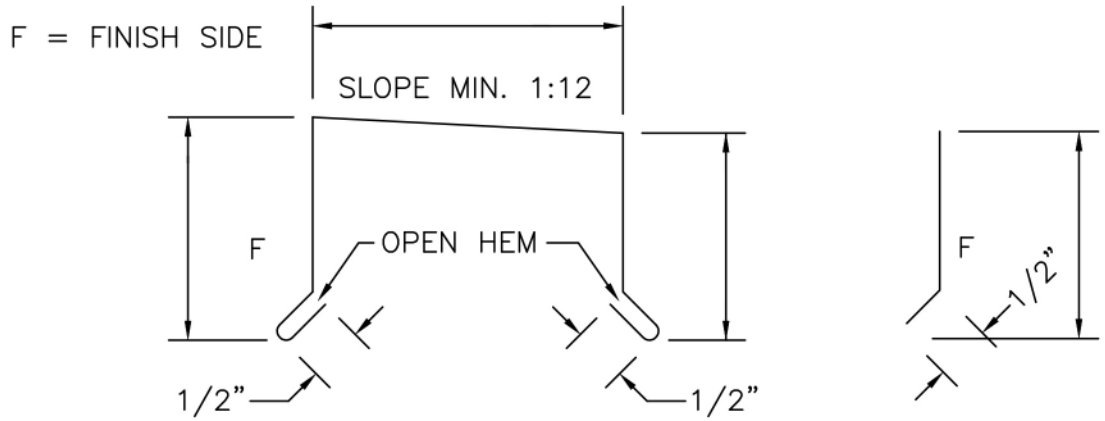


Berridge Manufacturing Company
Roofs of Distinction

PARAPET DETAIL

DATE: 03/22/08


FISH SCALE SHINGLE

PAGE\FILE
FSS-70

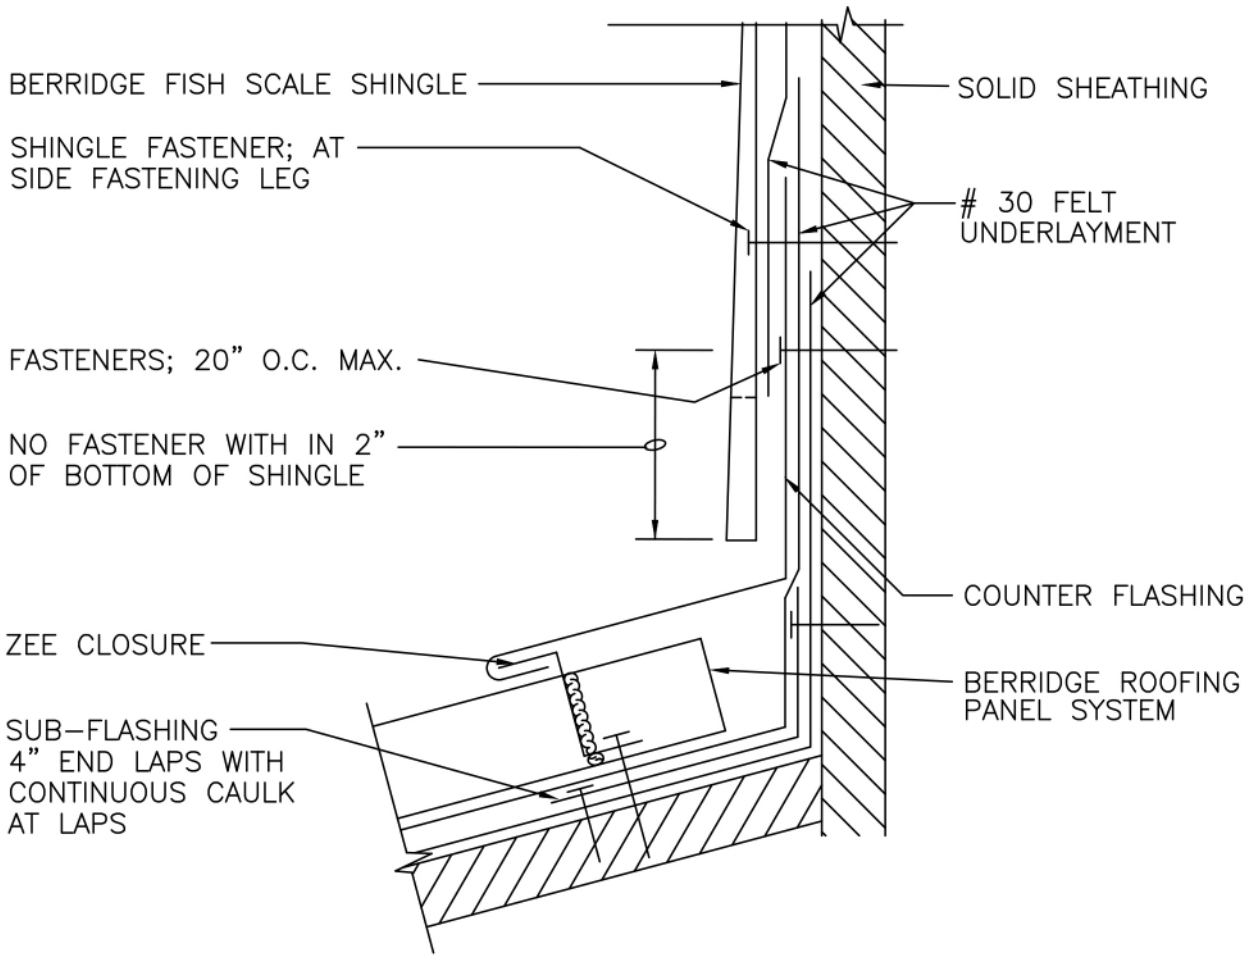


1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.


F = FINISH SIDE

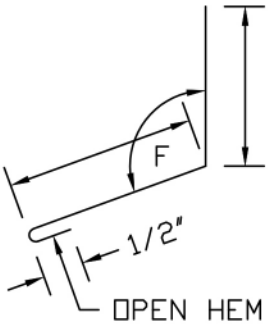

COUNTERFLASHING



SUB-FLASHING



ZEE CLOSURE


DATE: 03/22/08

HEAD WALL DETAIL


PAGE\FILE
FSS-71

FISH SCALE SHINGLE

Berridge Manufacturing Company
Roofs of Distinction

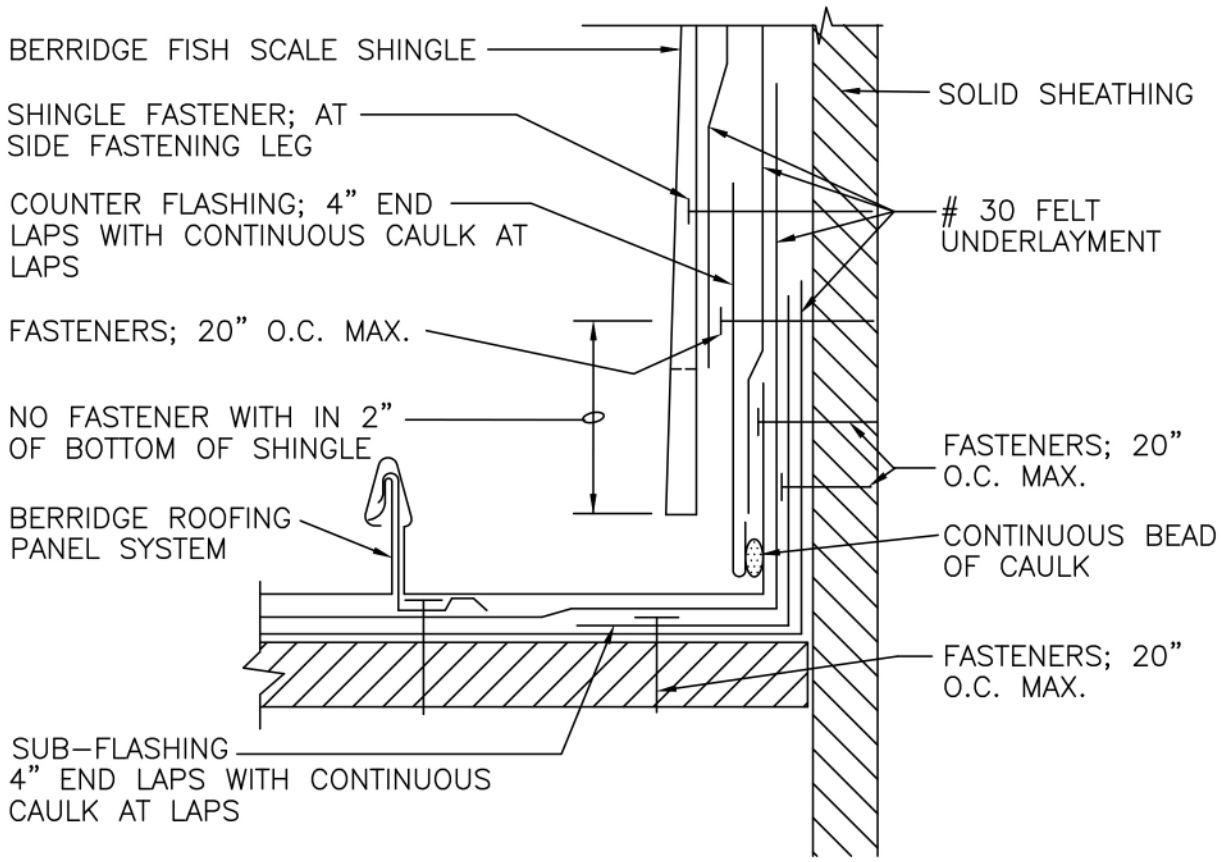

1. SOLID SHEATHING (BY OTHERS) TO BE MINIMUM 1/2" PLYWOOD OR EQUIVALENT IN STRENGTH FOR HOLDING POWER OF FASTENERS.
2. ALL FELT UNDERLAYMENT, CAULKING, AND FASTENERS, ARE ITEMS TO BE FURNISHED AND INSTALLED BY THE ROOFING INSTALLER AT THE DISCRETION OF THE ARCHITECT.

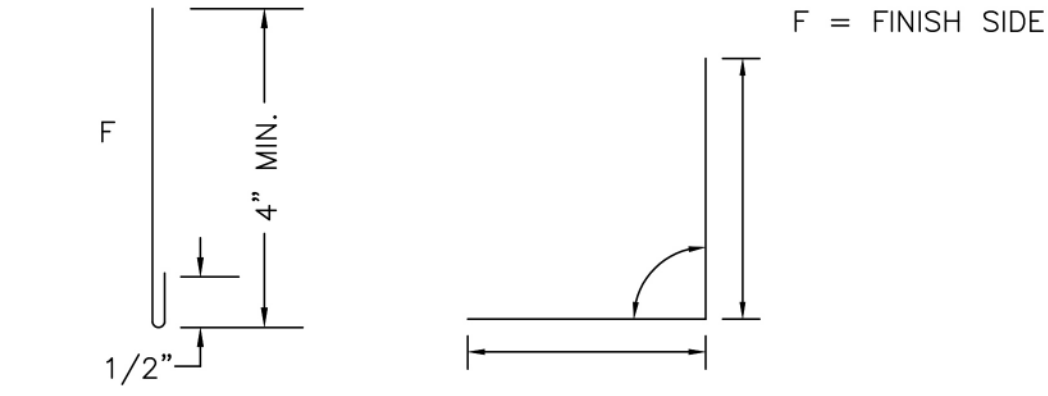

Berridge Manufacturing Company
Roofs of Distinction

RAKE WALL DETAIL

FISH SCALE SHINGLE

DATE: 03/22/08

PAGE\FILE
FSS-72